

# TEST DATA OF FSB-80-□□□

## Noise Filter

Oct. 17 , 2017

Approved by : Tadayuki Noda  
Tadayuki Noda Design Manager

Prepared by : Kenji Kamoi  
Kenji Kamoi Design Engineer

**COSEL CO.,LTD.**



## CONTENTS

1.Attenuation Characteristics .....	1
2.Leakage Current .....	4
3.Figure of Testing Circuitry .....	5

(Final Page 6)



# COSEL

Model	FSB-80-□□□	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object	_____		

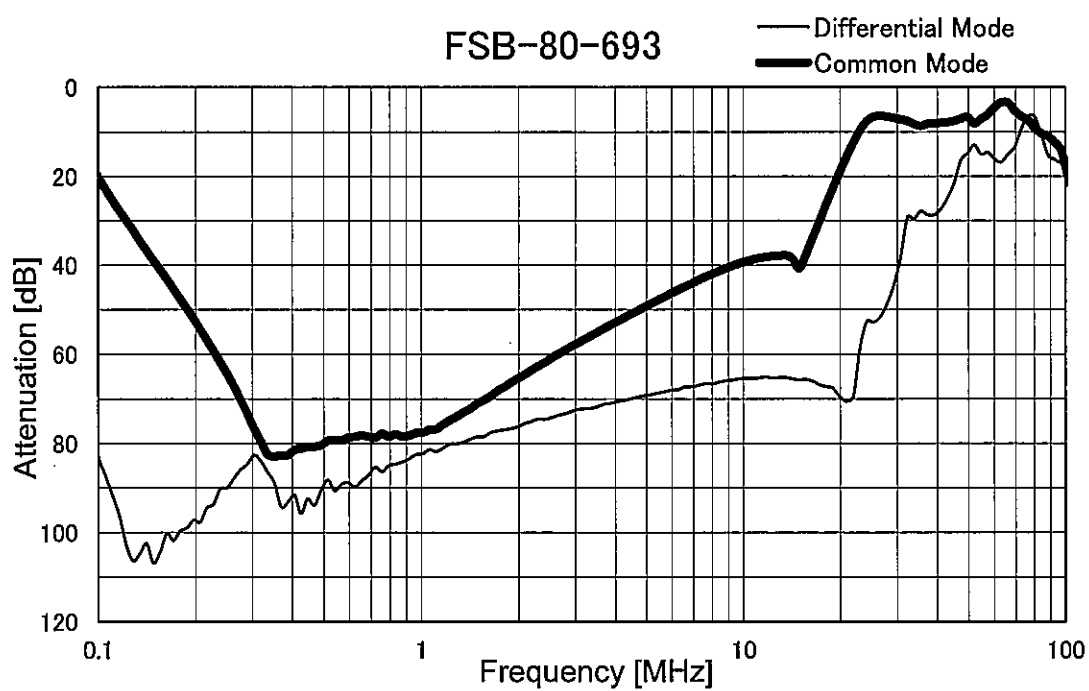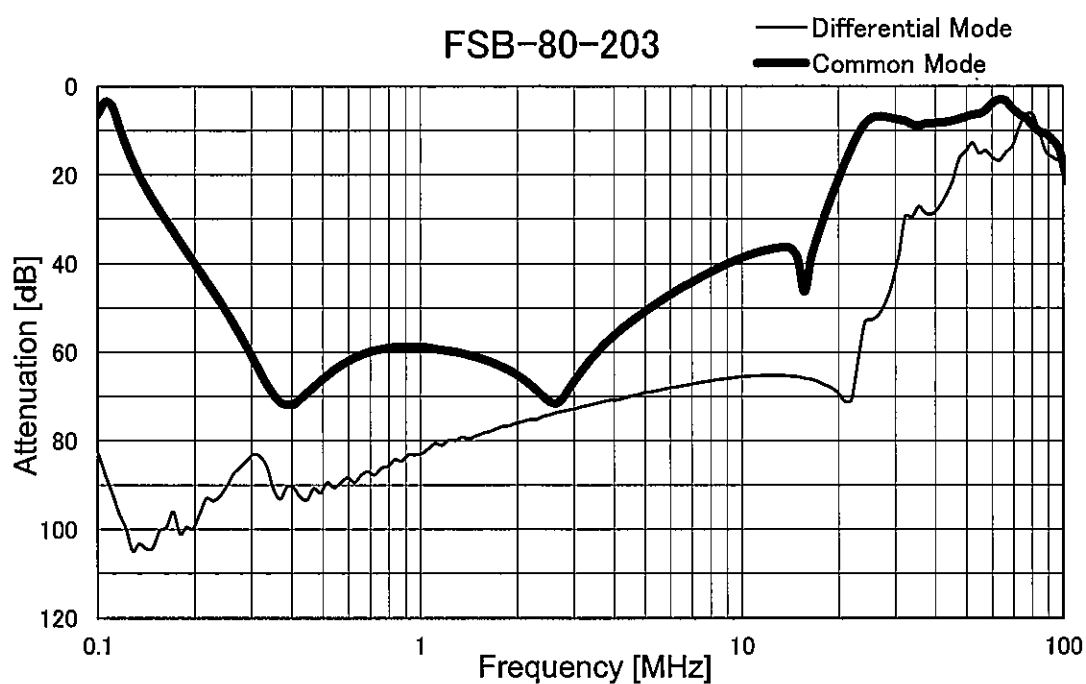


# COSEL

Model	FSB-80-□□□	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object	_____		

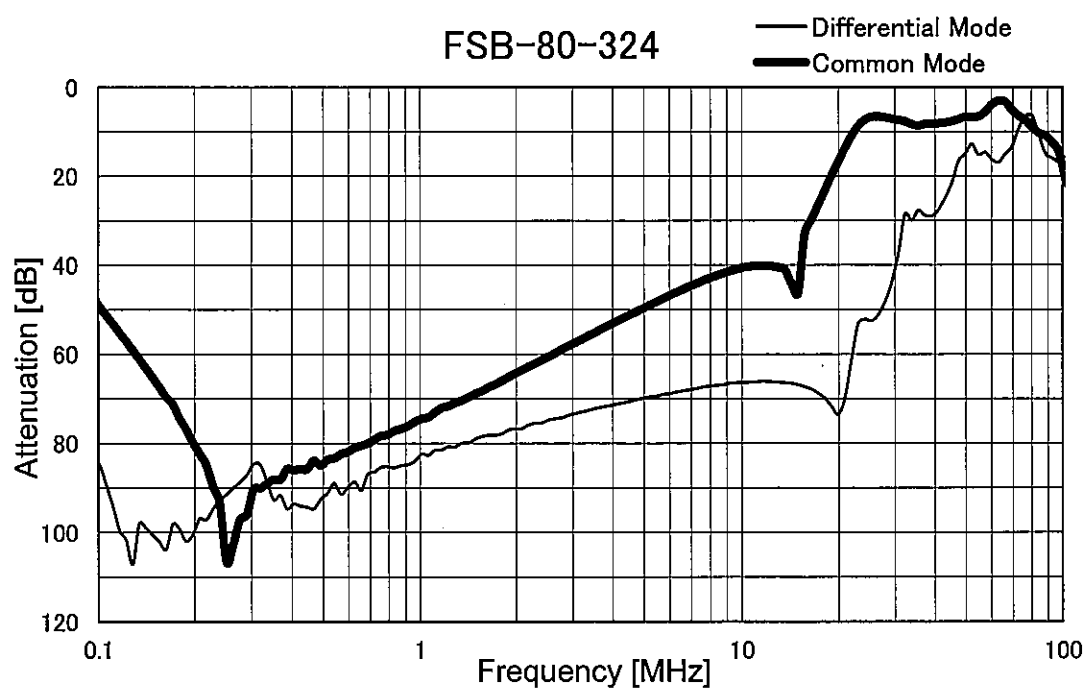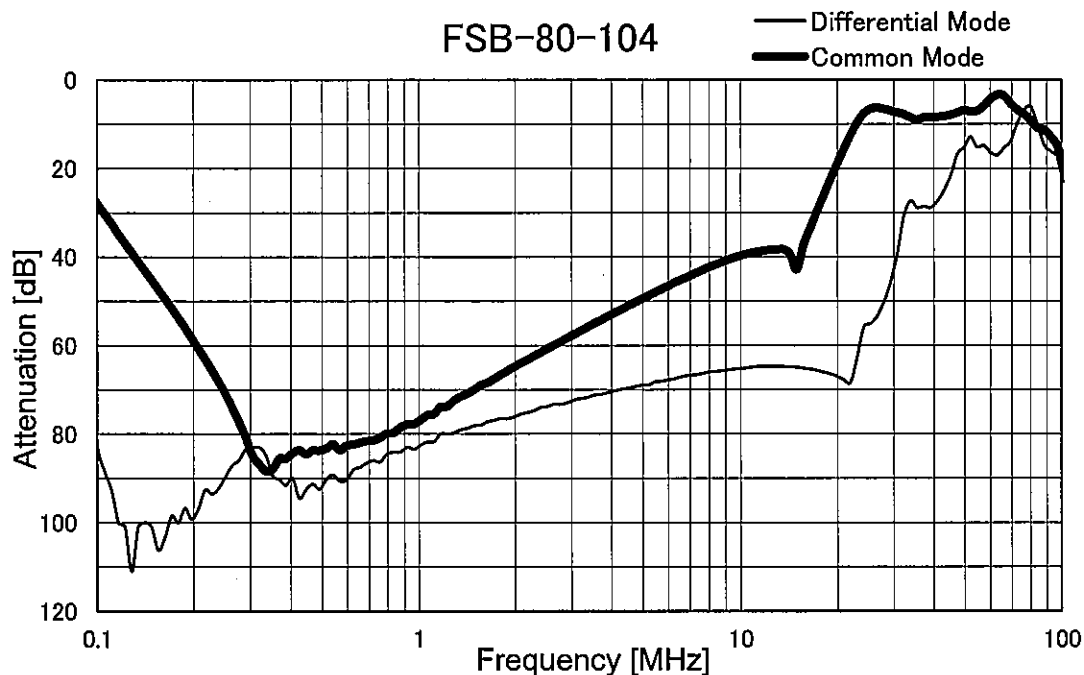

**COSEL**

Model	FSB-80-□□□	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object			

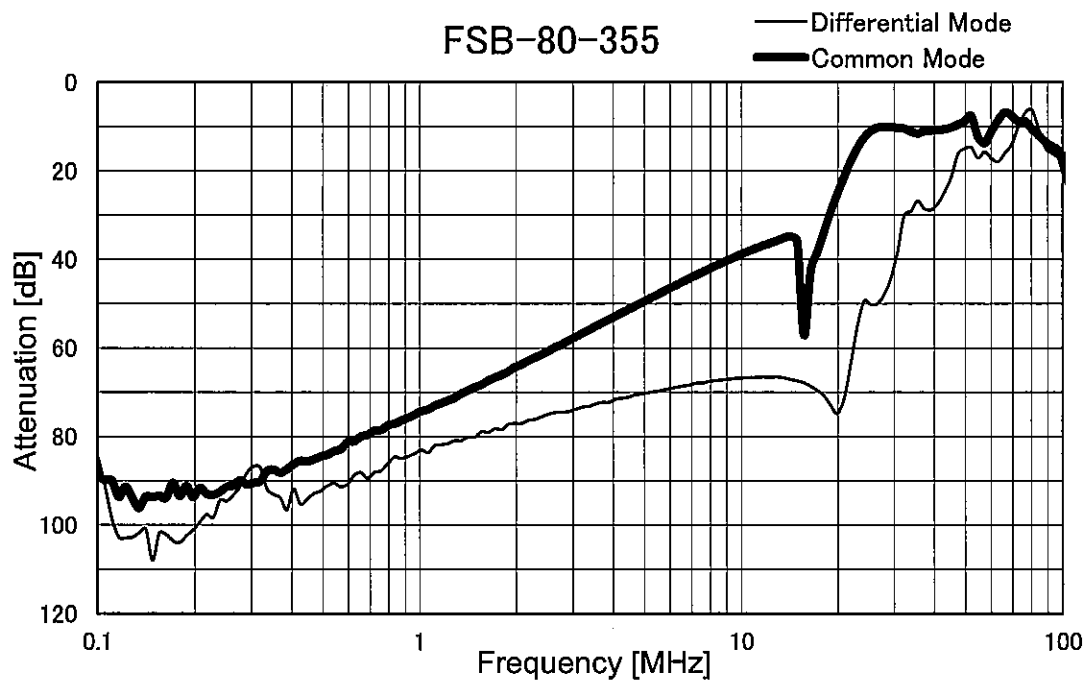

# COSEL

Model		FSB-80-□□□	Temperature 25°C Testing Circuitry Figure B
Item		Leakage Current	
Object		_____	

## 1.Results

[mA]

Model	Standards	Voltage system	Input Volt.					Note
			200[V]	250[V]	400[V]	480[V]	500[V]	
FSB-80-203	UL1283	Δ-connection	0.44	0.55	0.90	1.08	1.10	
		Wye-connection	0.003	0.003	0.010	0.010	0.010	
FSB-80-693	UL1283	Δ-connection	1.50	1.80	2.90	3.50	3.60	
		Wye-connection	0.008	0.008	0.010	0.012	0.012	
FSB-80-104	UL1283	Δ-connection	2.10	2.60	4.20	5.00	5.30	
		Wye-connection	0.005	0.006	0.010	0.012	0.013	
FSB-80-324	UL1283	Δ-connection	7.00	8.50	13.0	16.0	16.5	
		Wye-connection	0.025	0.028	0.035	0.037	0.040	
FSB-80-355	UL1283	Δ-connection	72.0	88.0	140			Δ-connection's rated voltage is 400V(440Vmax)
		Wye-connection	0.22	0.28	0.45	0.54	0.57	

## 2.Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

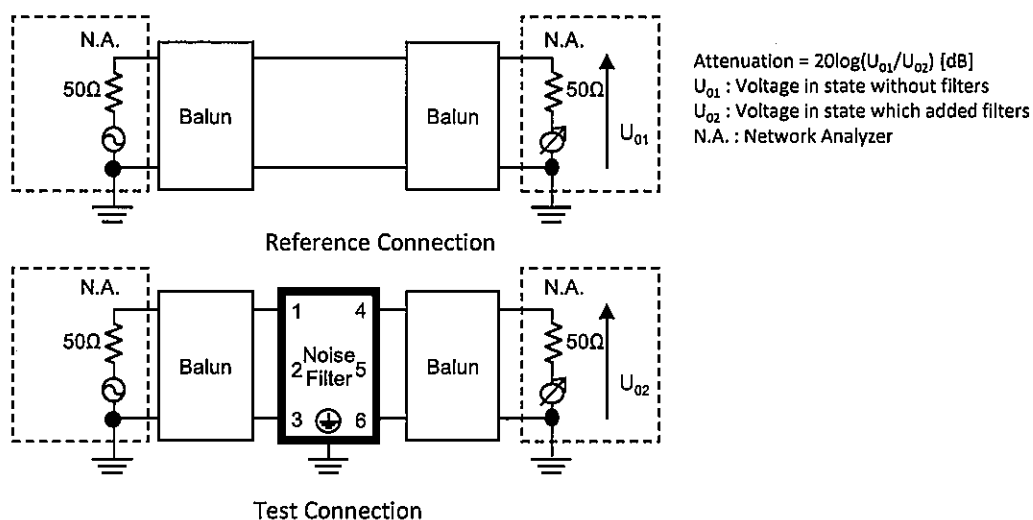


Figure A - 1 Differential mode attenuation measurement

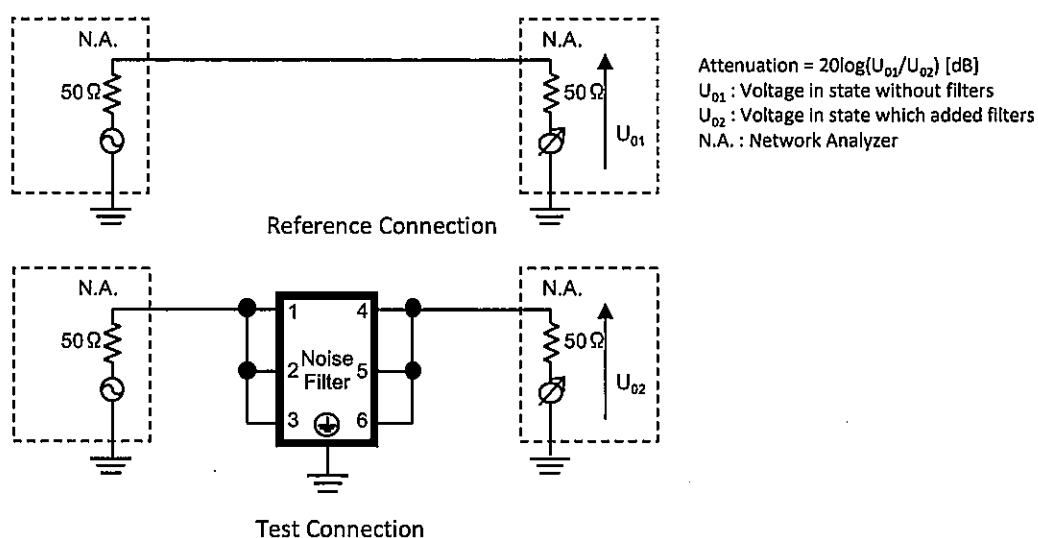


Figure A - 2 Common mode attenuation measurement

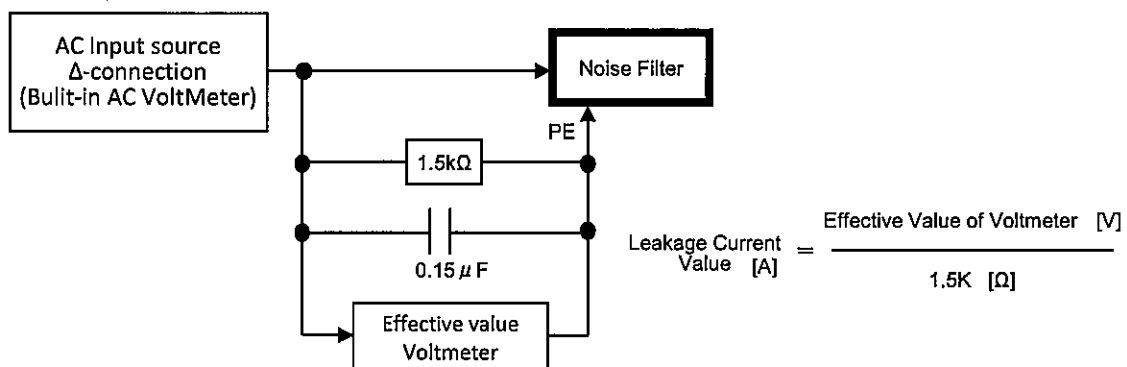


Figure B - 1 Leakage current measurement ( UL1283 Δ-connection)

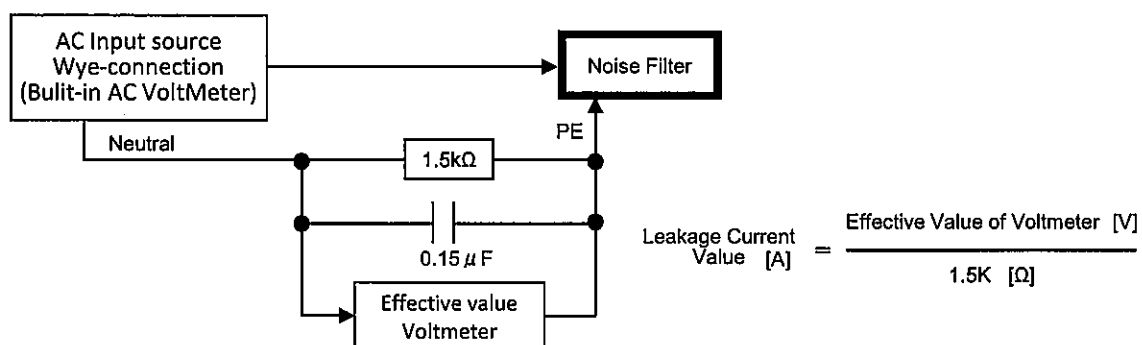


Figure B - 2 Leakage current measurement ( UL1283 Wye-connection)