

# TEST DATA OF FTA-50-□□□

## Noise Filter

December. 21. 2012

Approved by : Yuichi Uozu  
Yuichi Uozu Design Manager

Prepared by : Tadayuki Noda  
Tadayuki Noda Design Engineer

**COSEL CO.,LTD.**



## CONTENTS

1.Attenuation Characteristics . . . . .	1
2.Leakage Current . . . . .	3
3.Figure of Testing Circuitry . . . . .	4

(Final Page 4)



# COSEL

Model	FTA-50-□□□	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object	_____		

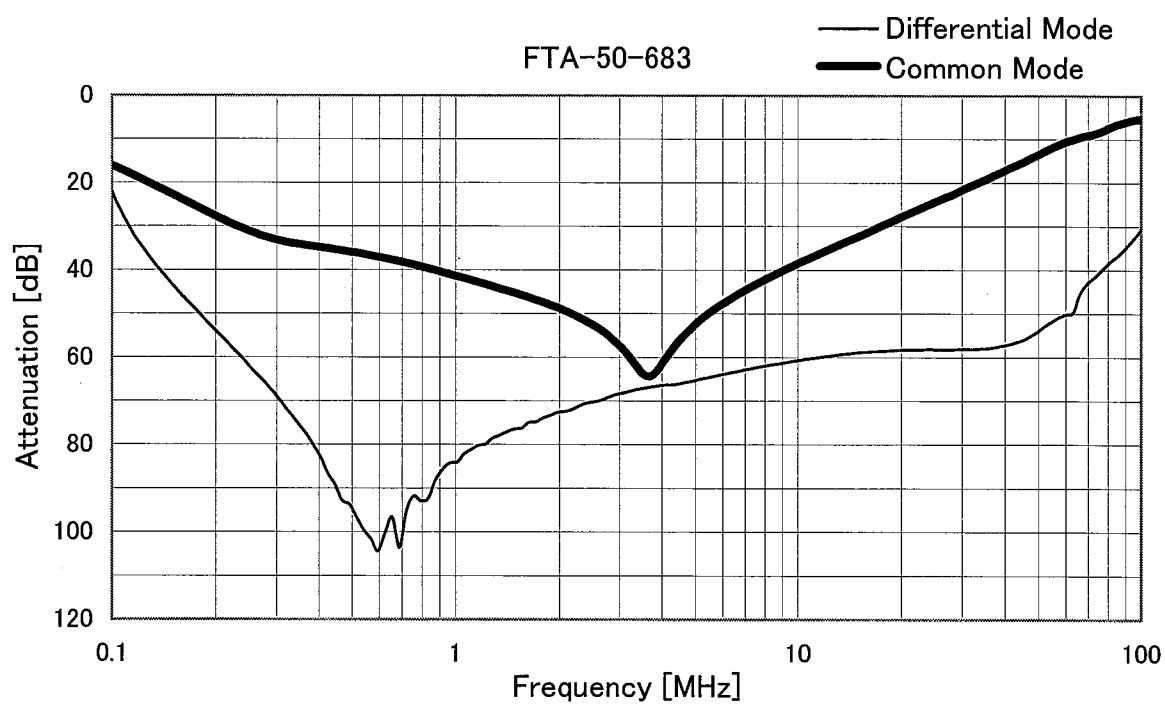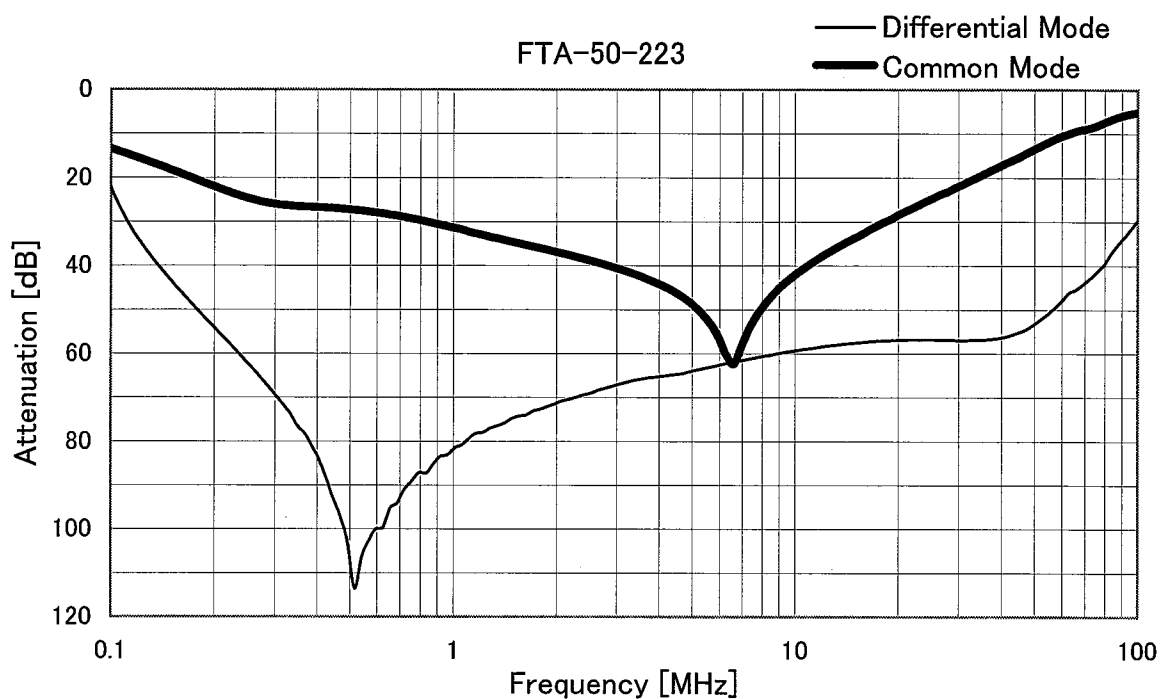

# COSEL

Model	FTA-50-□□□	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object	_____		

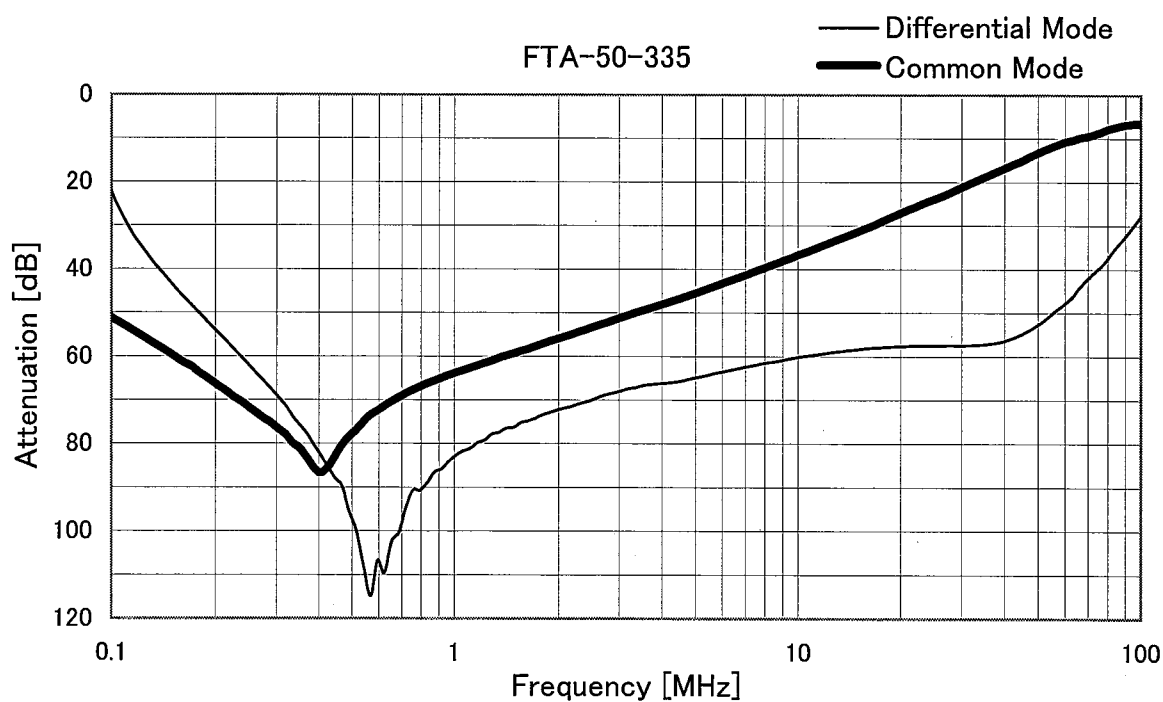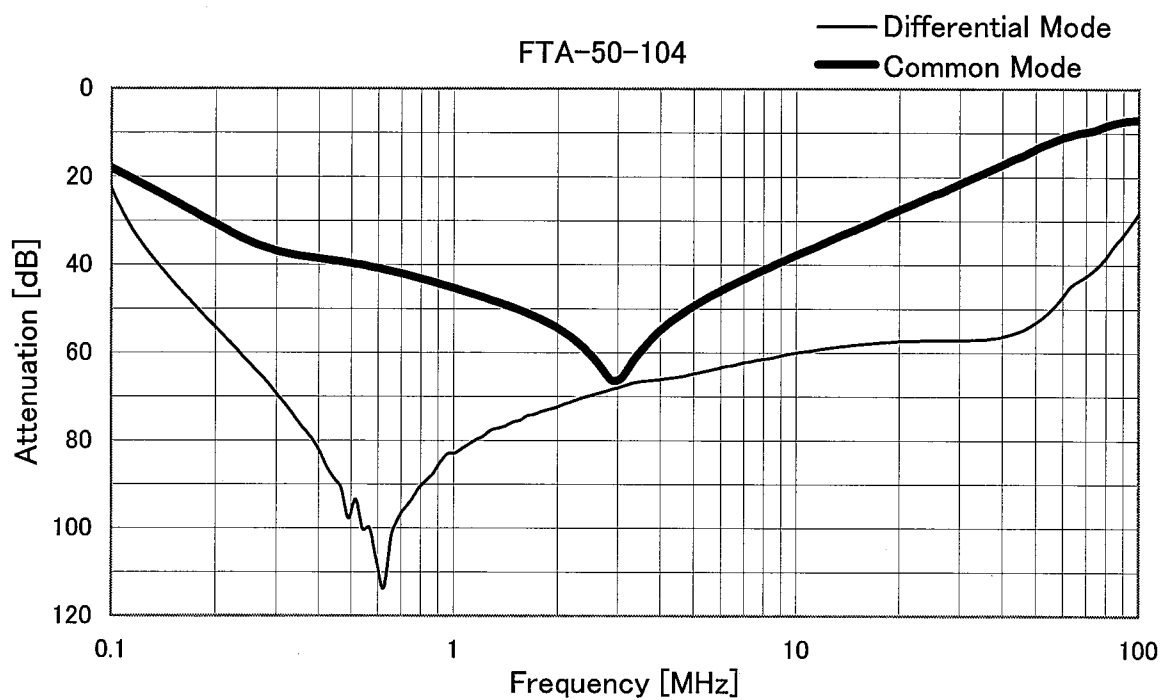

**COSEL**

Model		FTA-50-□□□	Temperature 25°C Testing Circuitry Figure B
Item		Leakage Current	
Object			

1.Results

[mA]

Model	Standards	Input Volt.					Note
		200 [V]	250 [V]	400 [V]	480 [V]	500 [V]	
FTA-50-223	UL1283	0.45	0.57	0.92	1.1	1.1	
FTA-50-683	UL1283	1.4	1.8	2.9	3.4	3.5	
FTA-50-104	UL1283	2.1	2.7	4.1	5.0	5.2	
FTA-50-335	UL1283	58.0	72.5	116.0			Δ-connection's rated voltage is 400V(440Vmax)

2.Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

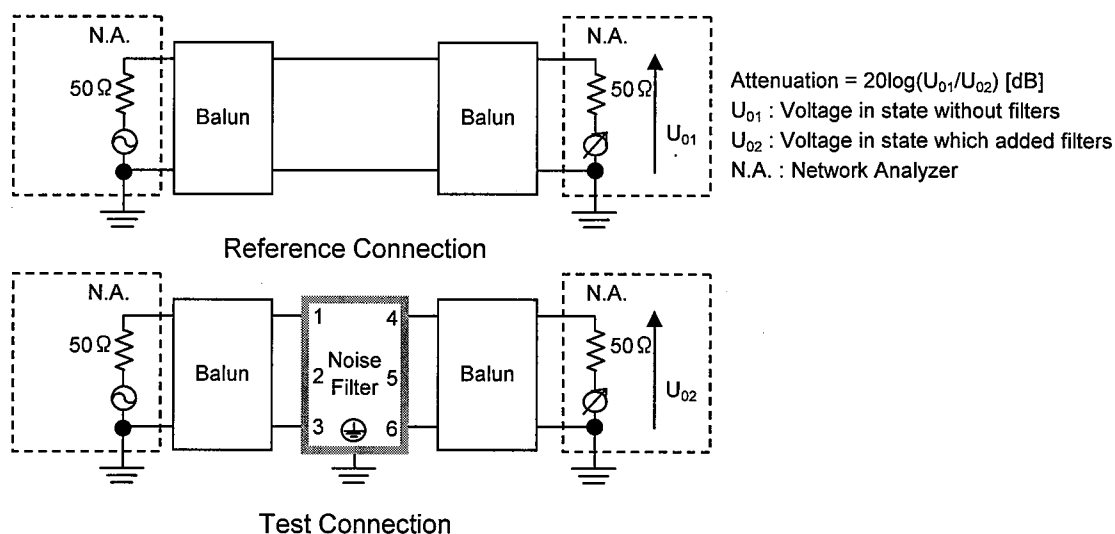


Figure A - 1 Differential mode attenuation measurement

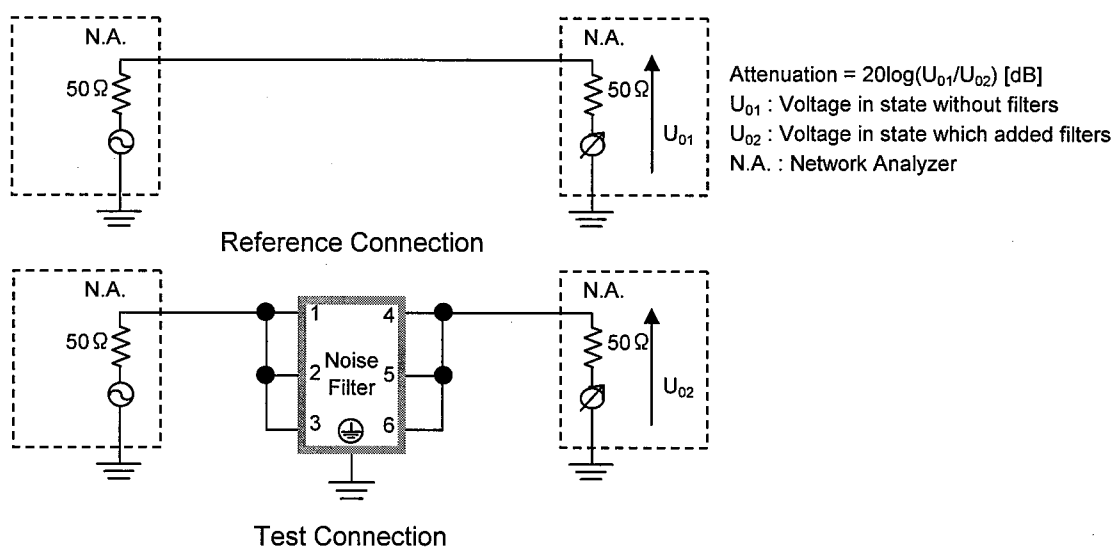


Figure A - 2 Common mode attenuation measurement

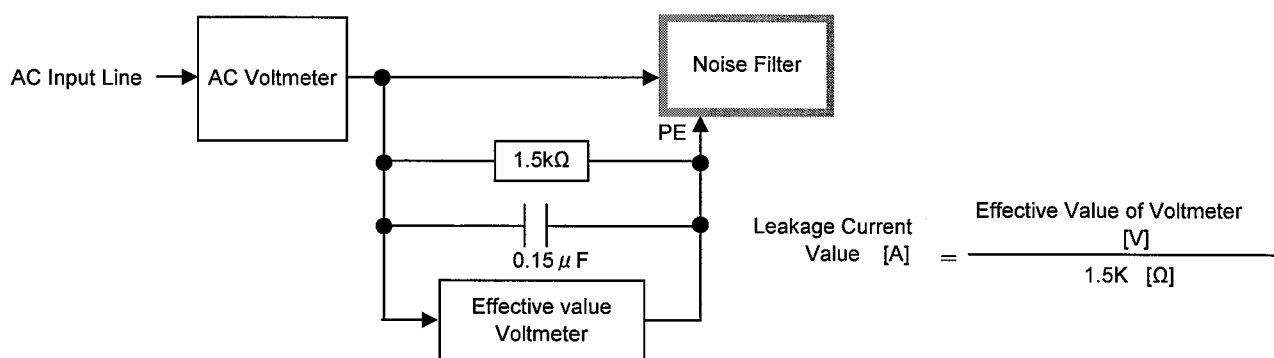


Figure B Leakage current measurement ( UL1283 )