



TEST DATA OF JAC-40-□□□

Noise Filter

Nov. 27 , 2019

Approved by : Tadayuki Noda
Tadayuki Noda Design Manager

Prepared by : Naoya Kunishima
Naoya Kunishima Design Engineer



COSEL CO.,LTD.

CONTENTS

1.Attenuation Characteristics	1
2.Leakage Current	4
3.Figure of Testing Circuitry	5
(Final Page 6)	





Model	JAC-40-□□□	Temperature 25°C Testing Circuitry Figure A
Item	Attenuation Characteristics	
Object	_____	

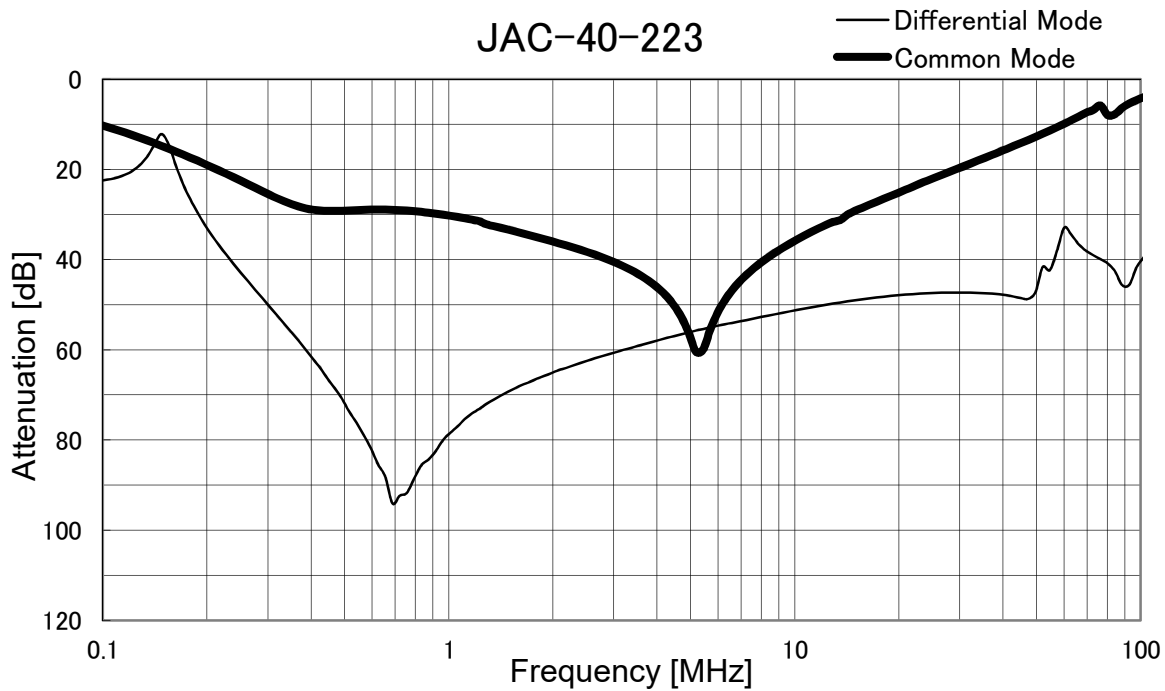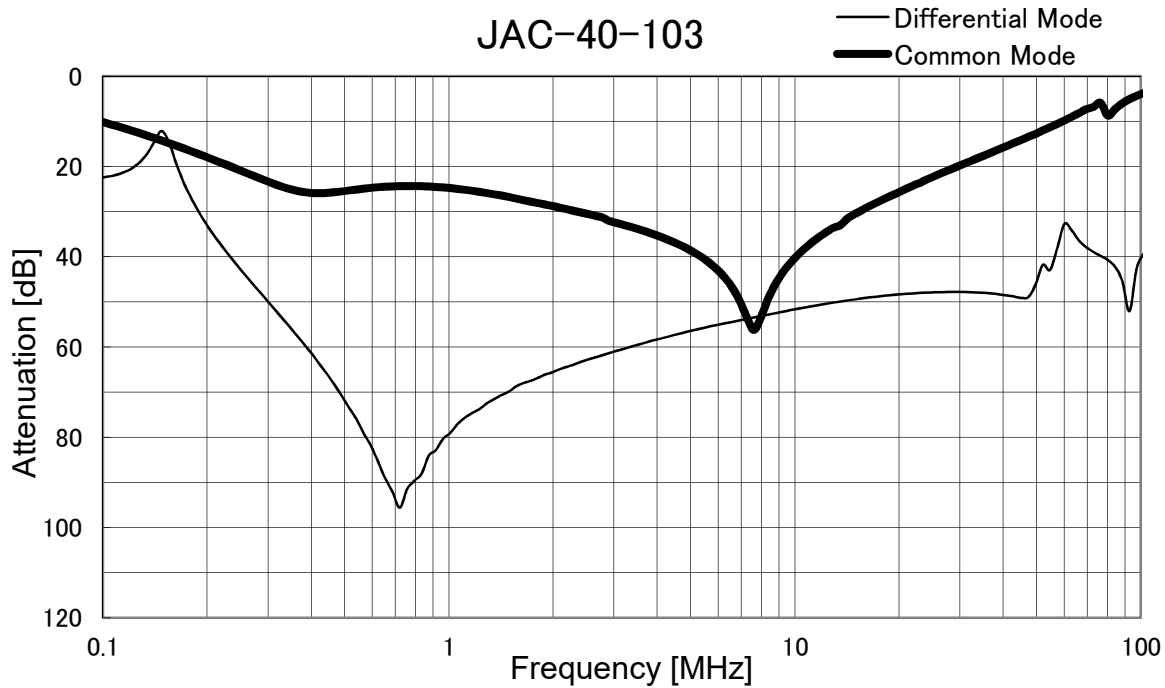




Model	JAC-40-□□□	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object			

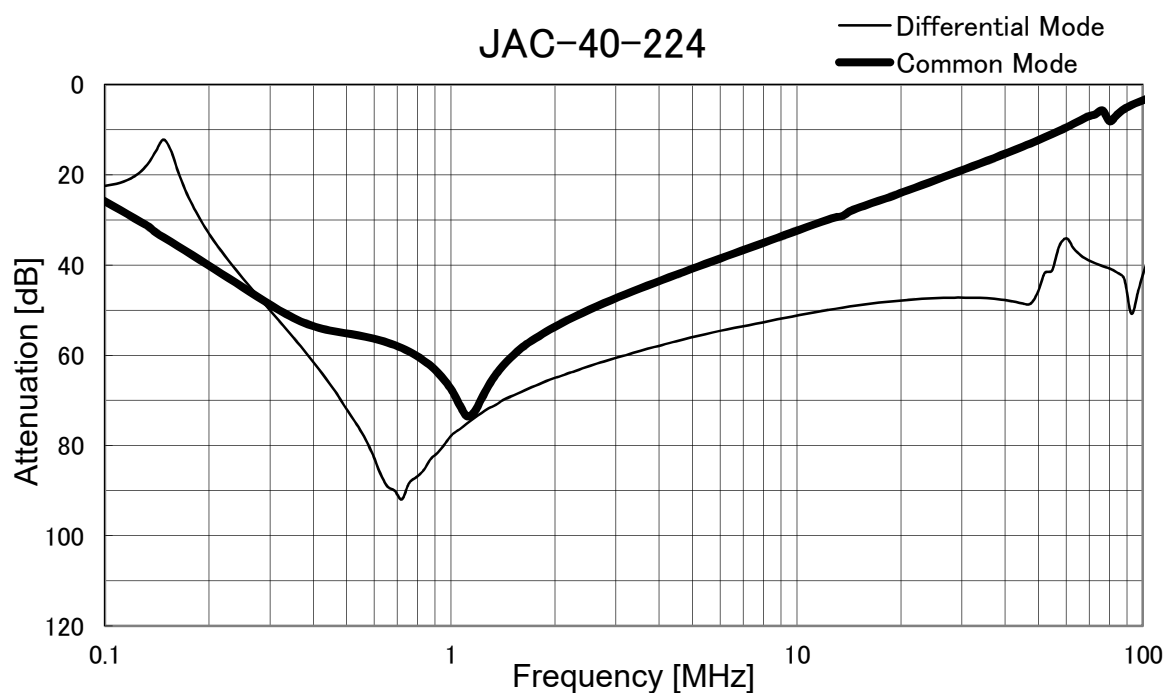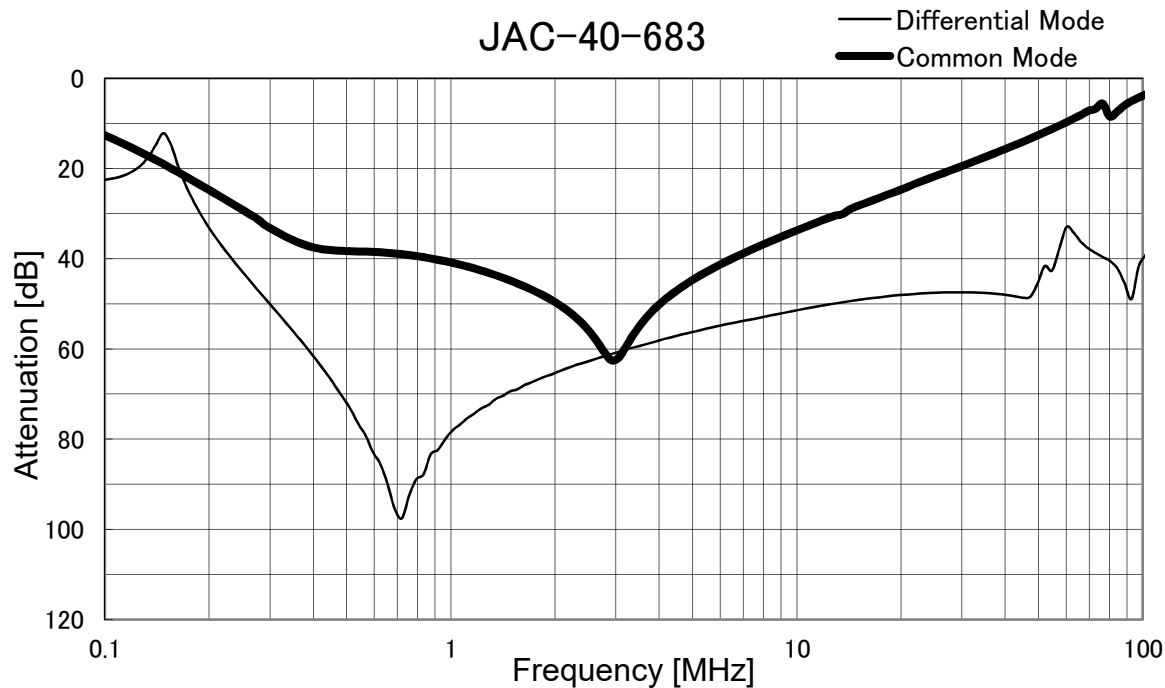



Model		JAC-40-□□□	Temperature 25°C Testing Circuitry Figure A
Item		Attenuation Characteristics	
Object		_____	

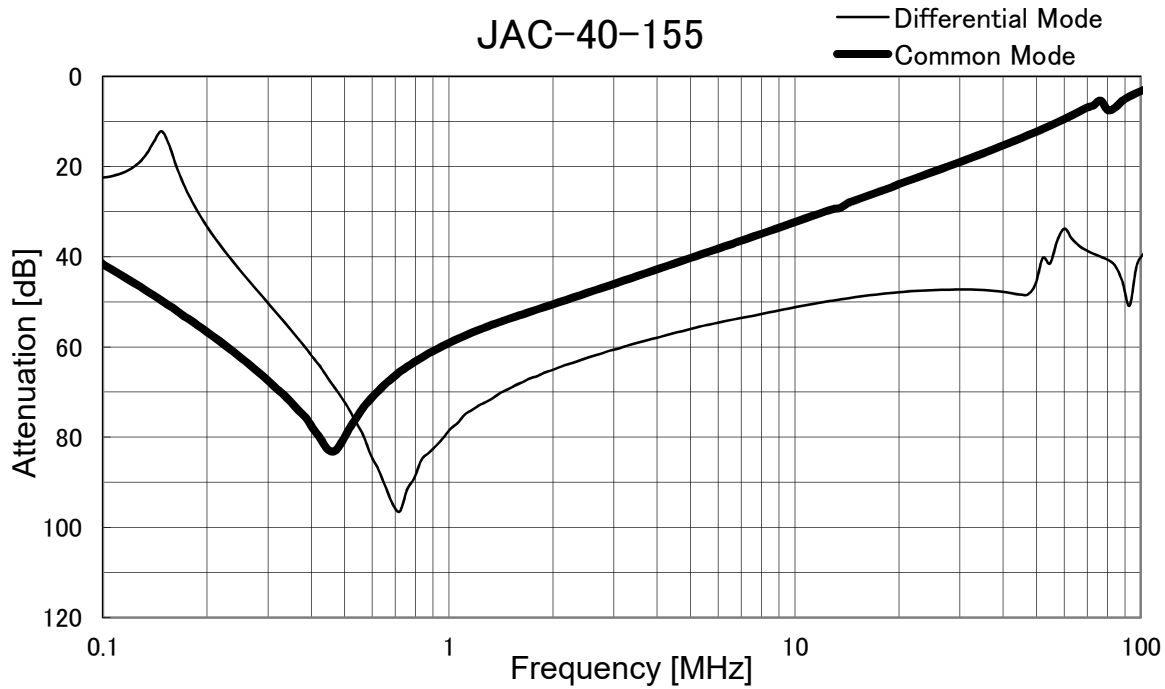



Model		JAC-40-□□□	Temperature 25°C Testing Circuitry Figure B
Item		Leakage Current	
Object		_____	

1.Results

[mA]

Model	Standards	Voltage system	Input Volt.					Note
			200[V]	250[V]	400[V]	480[V]	500[V]	
JAC-40-103	UL60939	Δ-connection	0.22	0.29	0.45	0.55	0.58	
		Y-connection	0.003	0.003	0.003	0.003	0.003	
JAC-40-223	UL60939	Δ-connection	0.46	0.58	0.92	1.05	1.10	
		Y-connection	0.001	0.002	0.003	0.003	0.003	
JAC-40-683	UL60939	Δ-connection	1.40	1.75	2.80	3.30	3.50	
		Y-connection	0.005	0.005	0.007	0.008	0.008	
JAC-40-224	UL60939	Δ-connection	8.20	10.0	16.4			Δ-connection's rated voltage is 400V(440Vmax)
		Y-connection	0.04	0.05	0.08	0.09	0.10	
JAC-40-155	UL60939	Δ-connection	39.0	49.0	77.0			Δ-connection's rated voltage is 400V(440Vmax)
		Y-connection	0.22	0.27	0.44	0.53	0.55	

2.Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

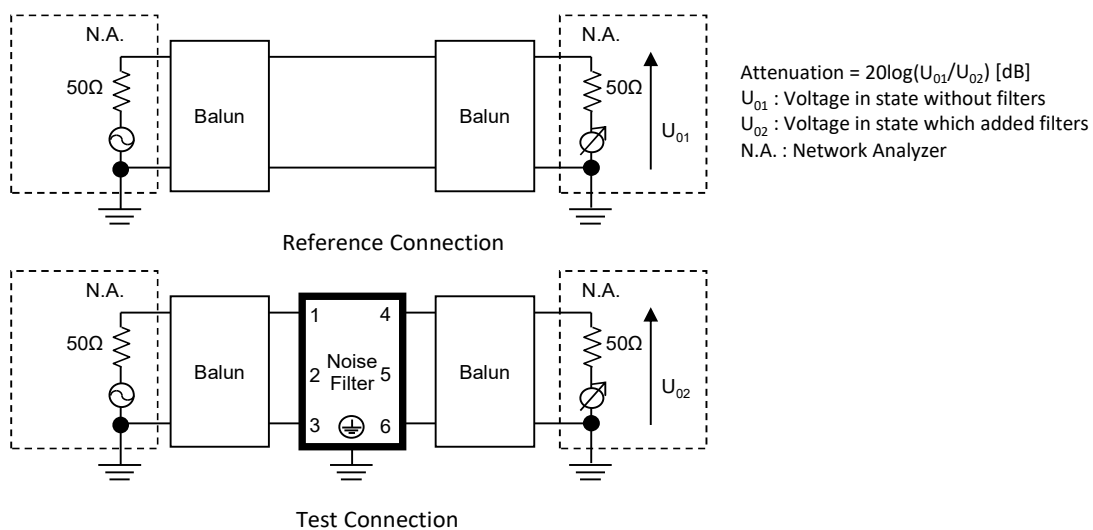


Figure A - 1 Differential mode attenuation measurement

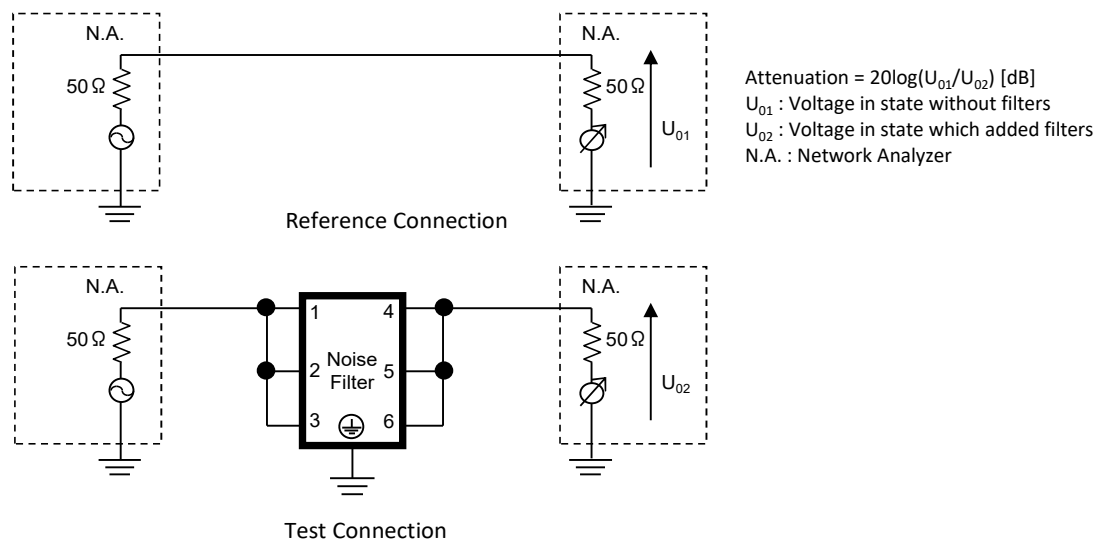


Figure A - 2 Common mode attenuation measurement

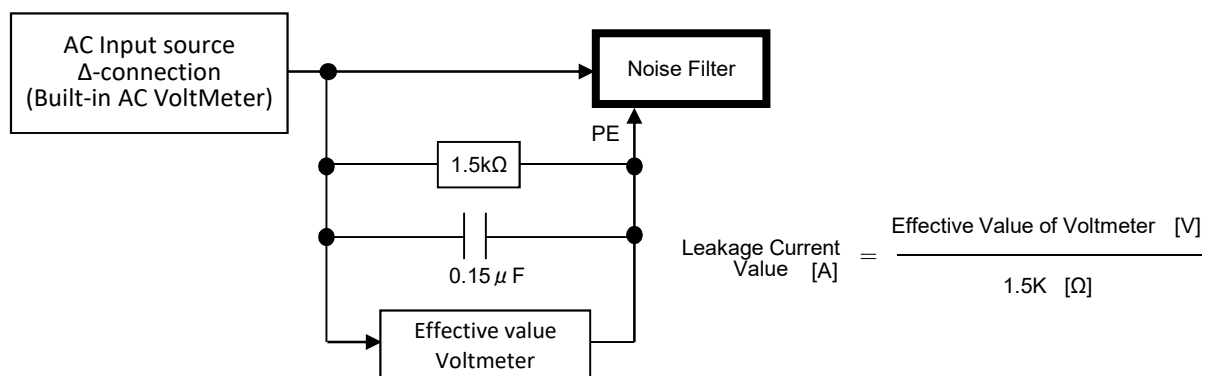


Figure B - 1 Leakage current measurement (UL60939 Δ-connection)

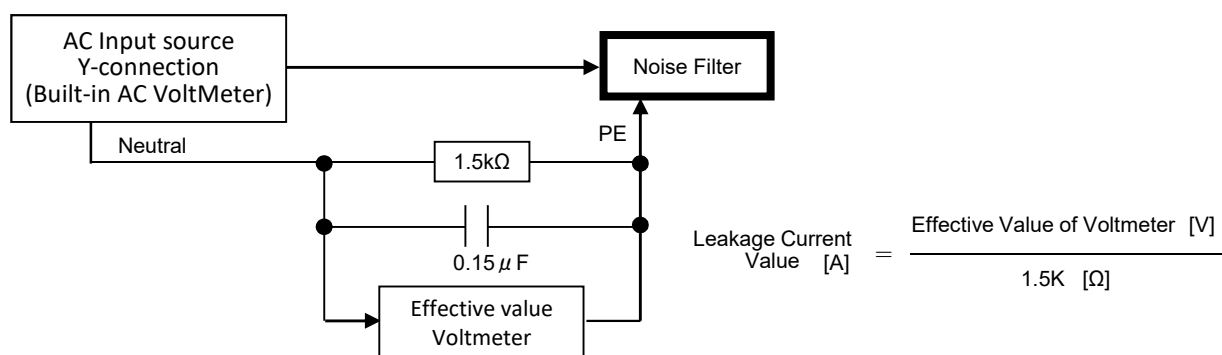


Figure B - 2 Leakage current measurement (UL60939 Y-connection)