



TEST DATA OF JAC-50-□□□-HU

Noise Filter

Dec. 17 , 2019

Approved by : Tadayuki Noda
Tadayuki Noda Design Manager

Prepared by : Naoya Kunishima
Naoya Kunishima Design Engineer



COSEL CO.,LTD.

CONTENTS

1.Attenuation Characteristics	1
2.Leakage Current	3
3.Figure of Testing Circuitry	4
(Final Page 5)	




Model	JAC-50-□□□-HU	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object			

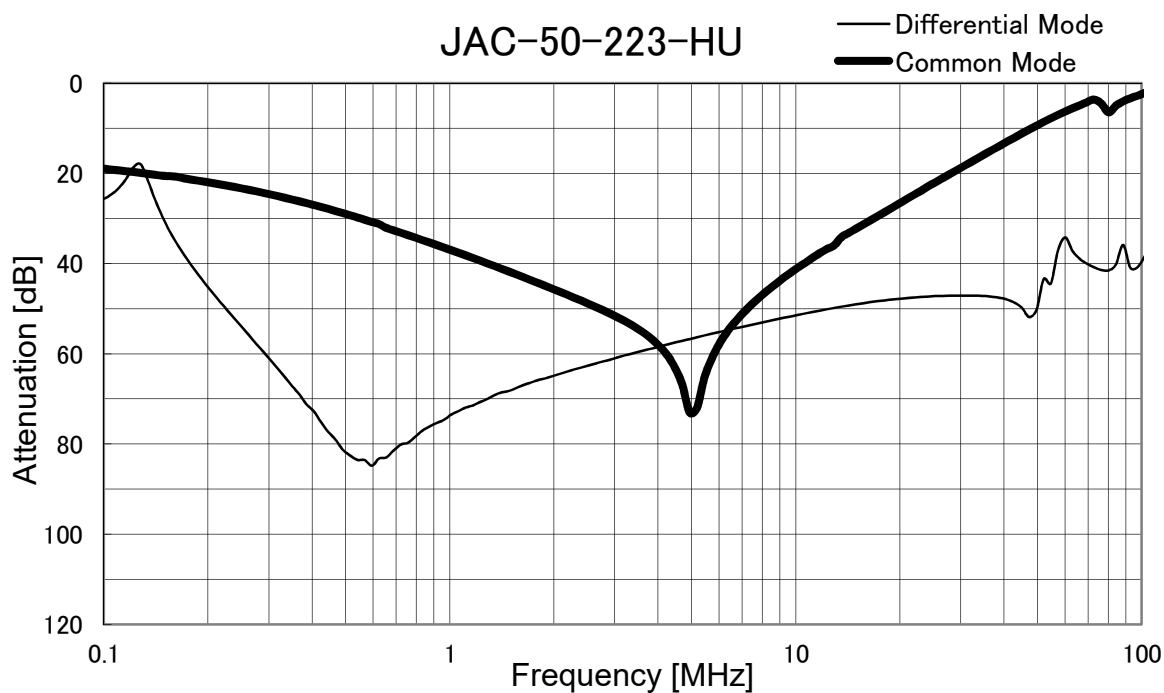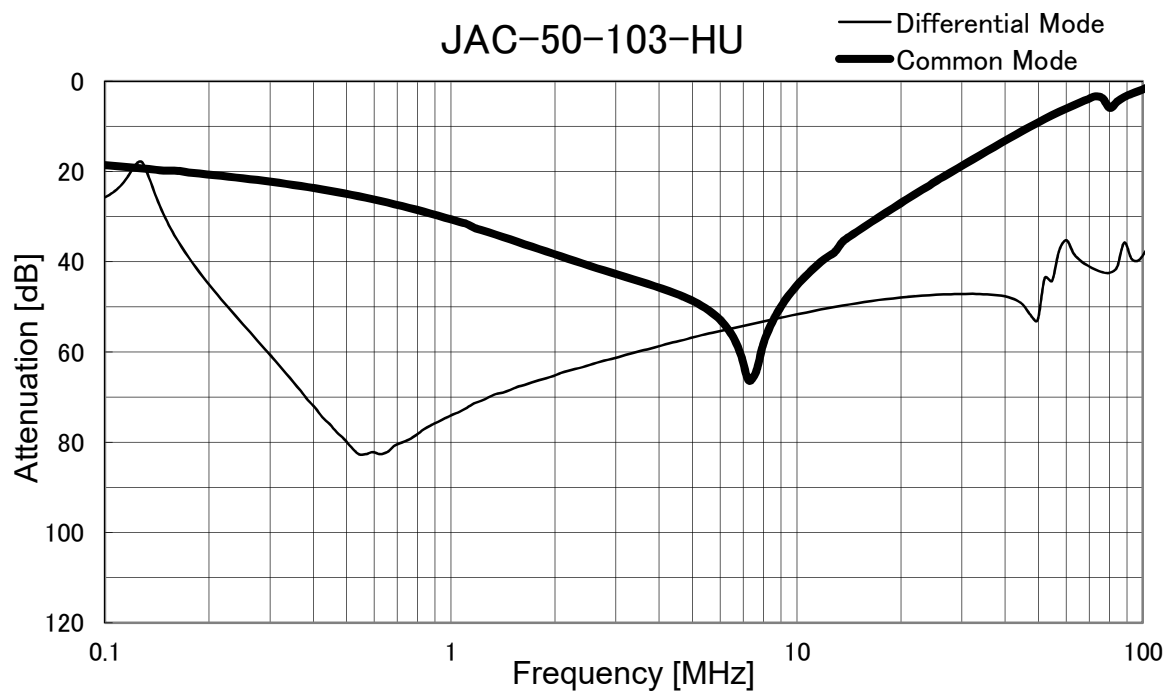



Model	JAC-50-□□□-HU	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object			

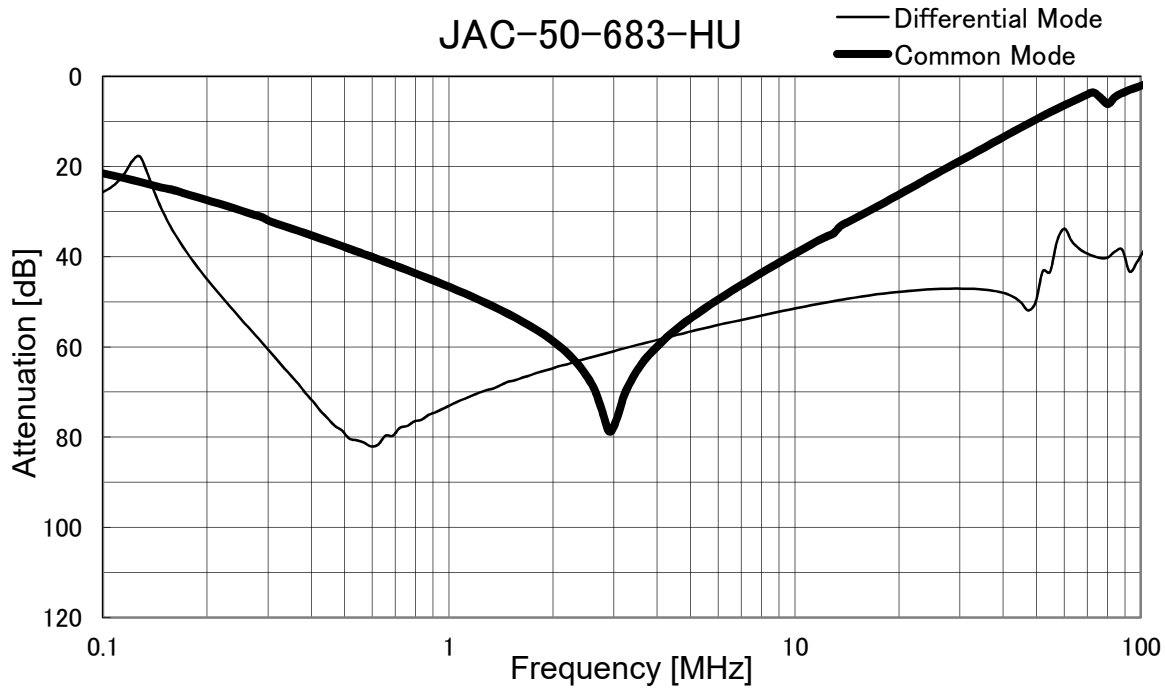



Model		JAC-50-□□□-HU	Temperature 25°C Testing Circuitry Figure B
Item		Leakage Current	
Object		_____	

1.Results

[mA]

Model	Standards	Voltage system	Input Volt.					Note
			200[V]	250[V]	400[V]	480[V]	500[V]	
JAC-50-103-HU	UL60939	Δ-connection	0.22	0.29				Rated voltage 250V(275Vmax)
		Y-connection	0.003	0.003				Rated voltage 250V(275Vmax)
JAC-50-223-HU	UL60939	Δ-connection	0.46	0.58				Rated voltage 250V(275Vmax)
		Y-connection	0.001	0.002				Rated voltage 250V(275Vmax)
JAC-50-683-HU	UL60939	Δ-connection	1.40	1.75				Rated voltage 250V(275Vmax)
		Y-connection	0.005	0.005				Rated voltage 250V(275Vmax)

2.Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

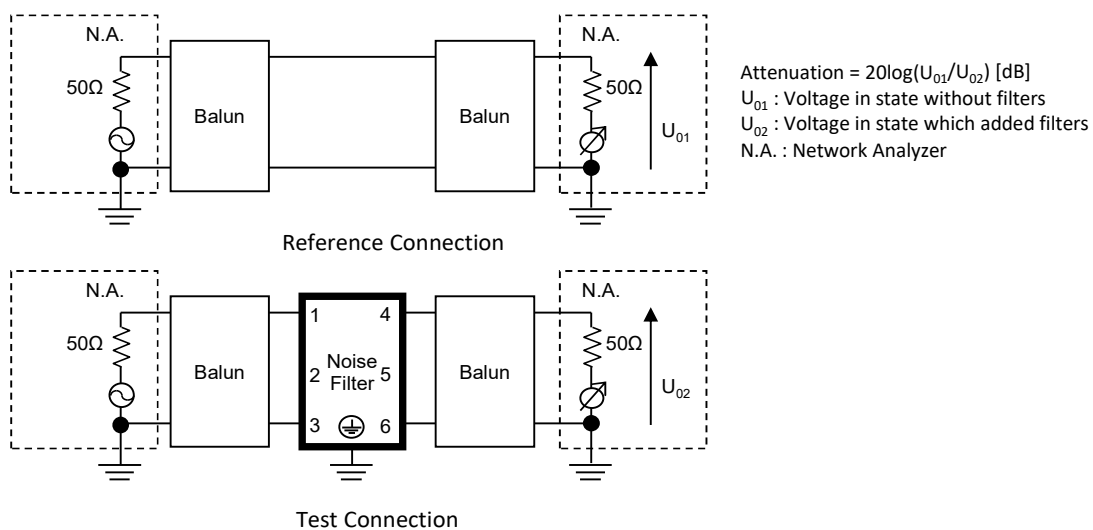


Figure A - 1 Differential mode attenuation measurement

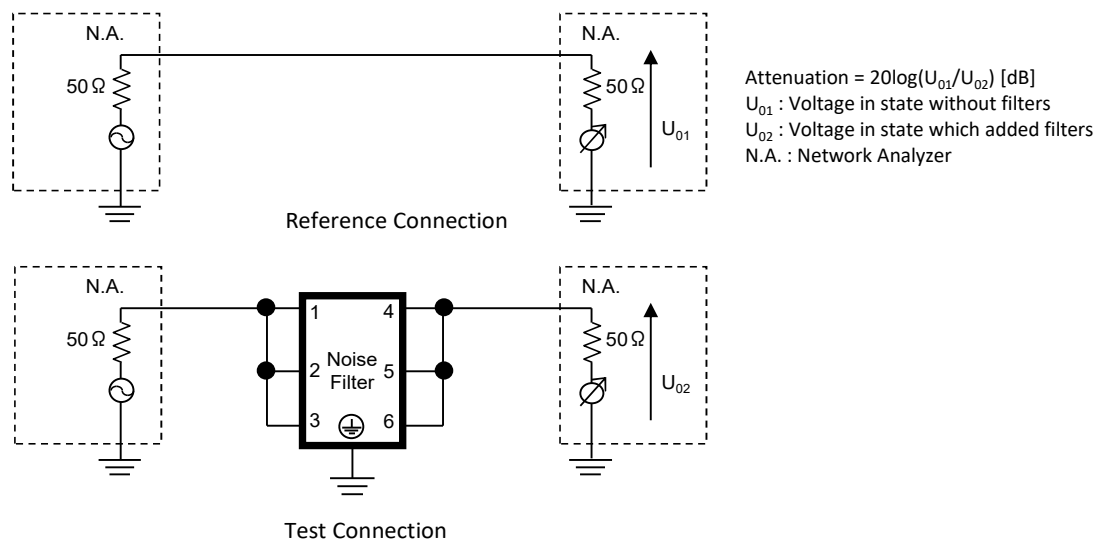


Figure A - 2 Common mode attenuation measurement

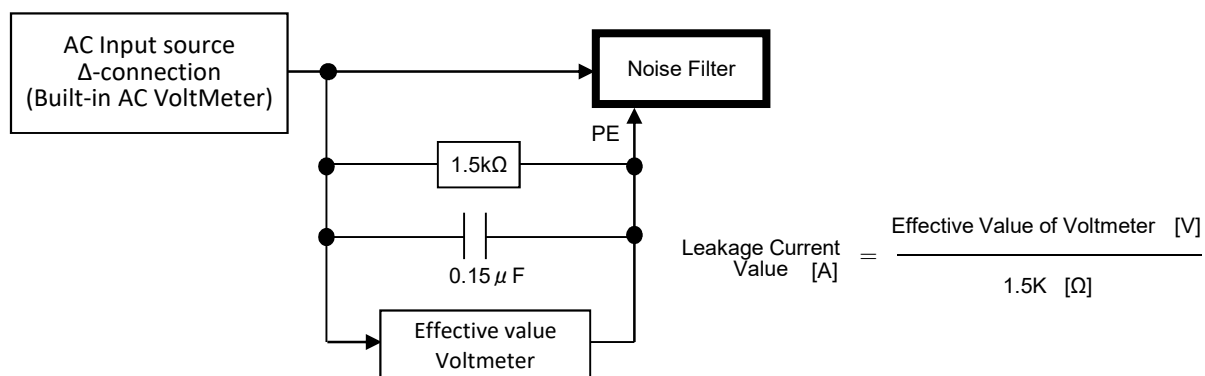


Figure B - 1 Leakage current measurement (UL60939 Δ-connection)

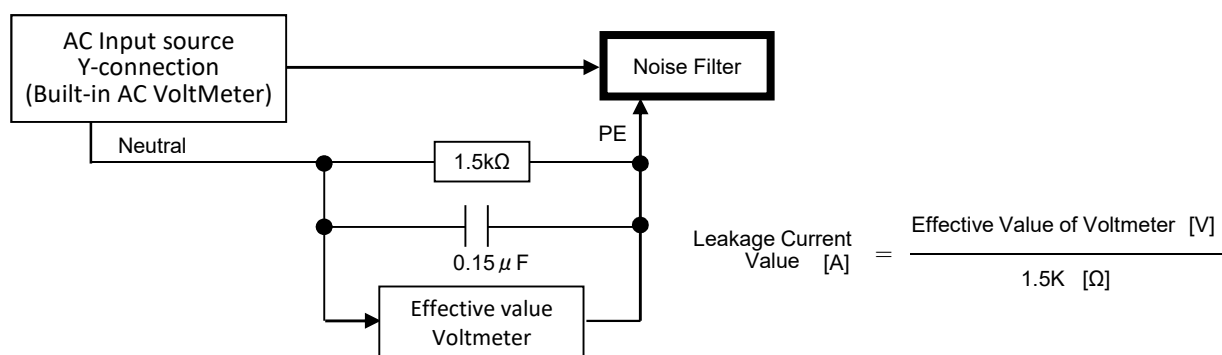


Figure B - 2 Leakage current measurement (UL60939 Y-connection)