



TEST DATA OF JAC-60-□□□-HU

Noise Filter

Dec. 17 , 2019

Approved by : Tadayuki Noda
Tadayuki Noda

Tadayuki Noda

Design Manager

Prepared by :

Norita, Kunishima

Naoya Kunishima

Design Engineer

COSEL CO.,LTD.




CONTENTS

1.Attenuation Characteristics	1
2.Leakage Current	3
3.Figure of Testing Circuitry	4
(Final Page 5)	


COSEL

Model	JAC-60-□□□-HU	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object	—		

JAC-60-103-HU

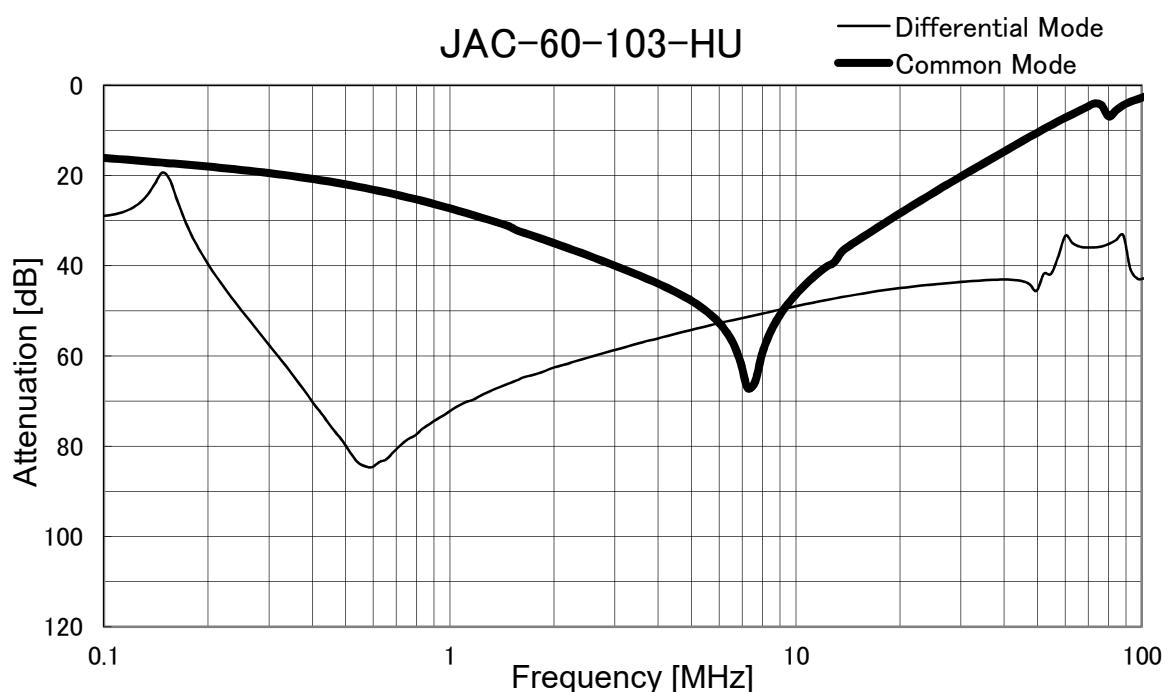


JAC-60-223-HU

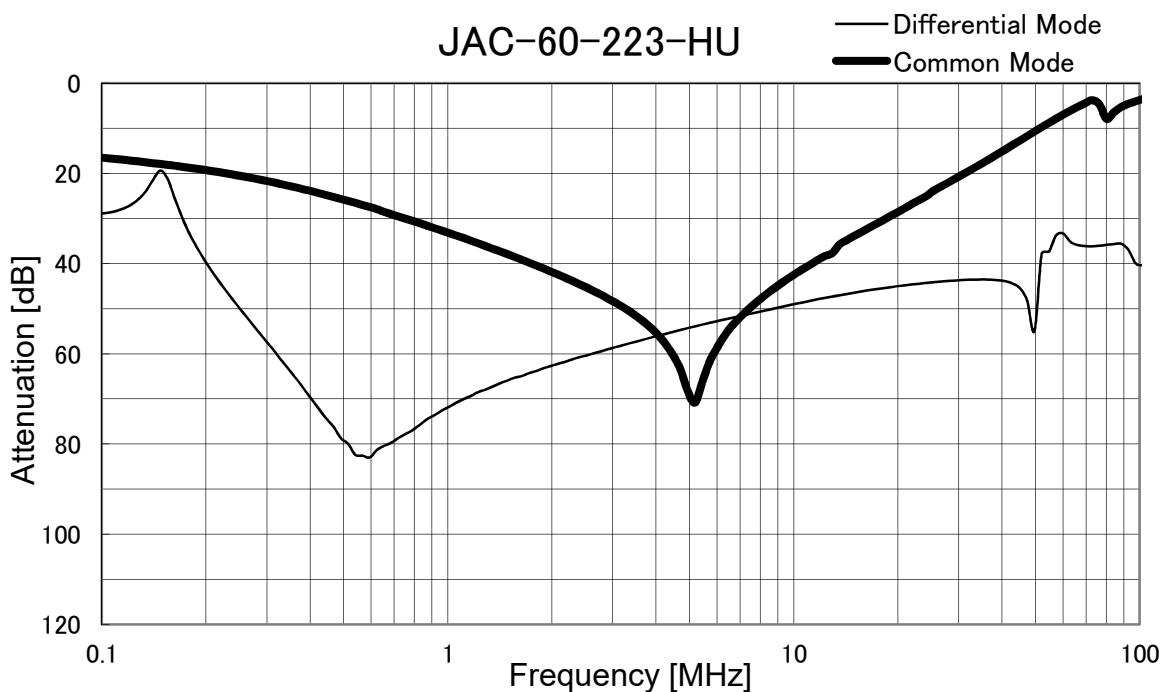

coSEL

Model	JAC-60-□□□-HU	Temperature	25°C
Item	Attenuation Characteristics	Testing Circuitry	Figure A
Object	_____		

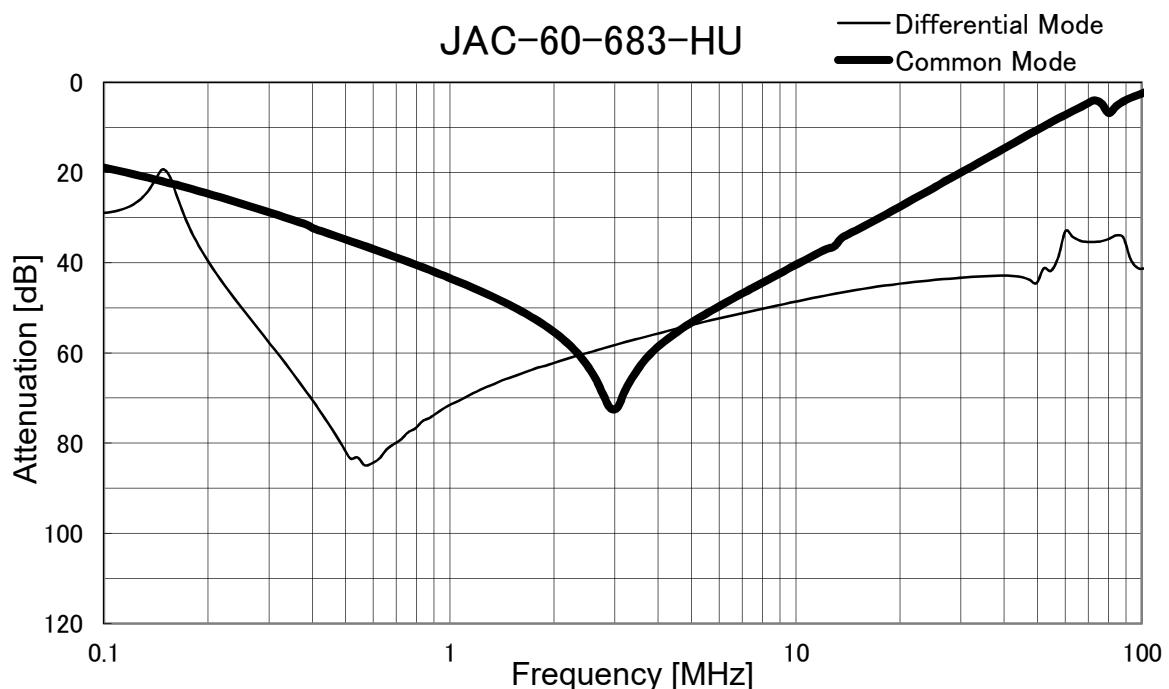



Model	JAC-60-□□□-HU	Temperature Testing Circuitry	25°C Figure B
Item	Leakage Current		
Object	_____		

1. Results

[mA]

Model	Standards	Voltage system	Input Volt.					Note
			200[V]	250[V]	400[V]	480[V]	500[V]	
JAC-60-103-HU	UL60939	Δ-connection	0.22	0.29	/	/	/	Rated voltage 250V(275Vmax)
		Y-connection	0.003	0.003	/	/	/	Rated voltage 250V(275Vmax)
JAC-60-223-HU	UL60939	Δ-connection	0.46	0.58	/	/	/	Rated voltage 250V(275Vmax)
		Y-connection	0.001	0.002	/	/	/	Rated voltage 250V(275Vmax)
JAC-60-683-HU	UL60939	Δ-connection	1.40	1.75	/	/	/	Rated voltage 250V(275Vmax)
		Y-connection	0.005	0.005	/	/	/	Rated voltage 250V(275Vmax)

2. Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

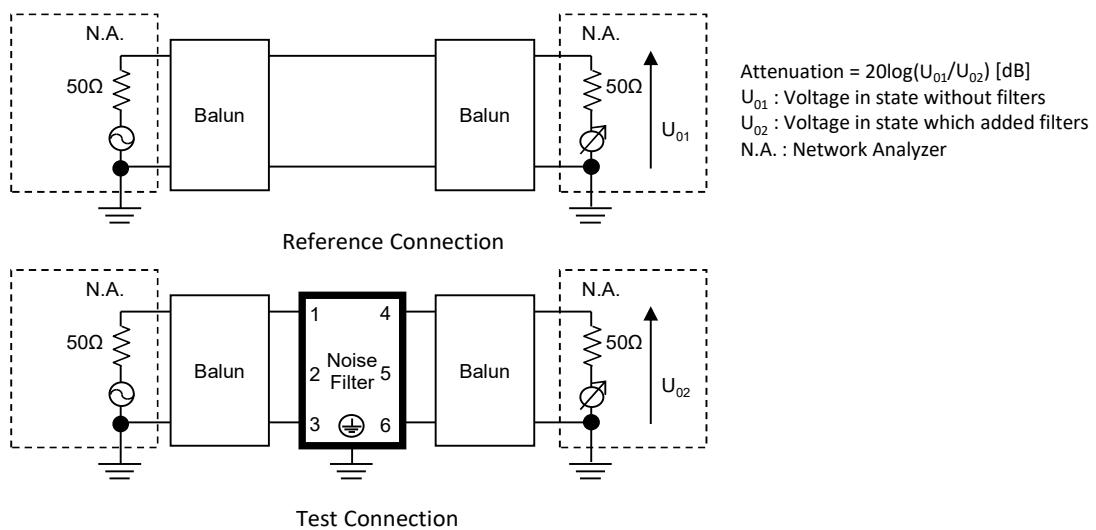


Figure A - 1 Differential mode attenuation measurement

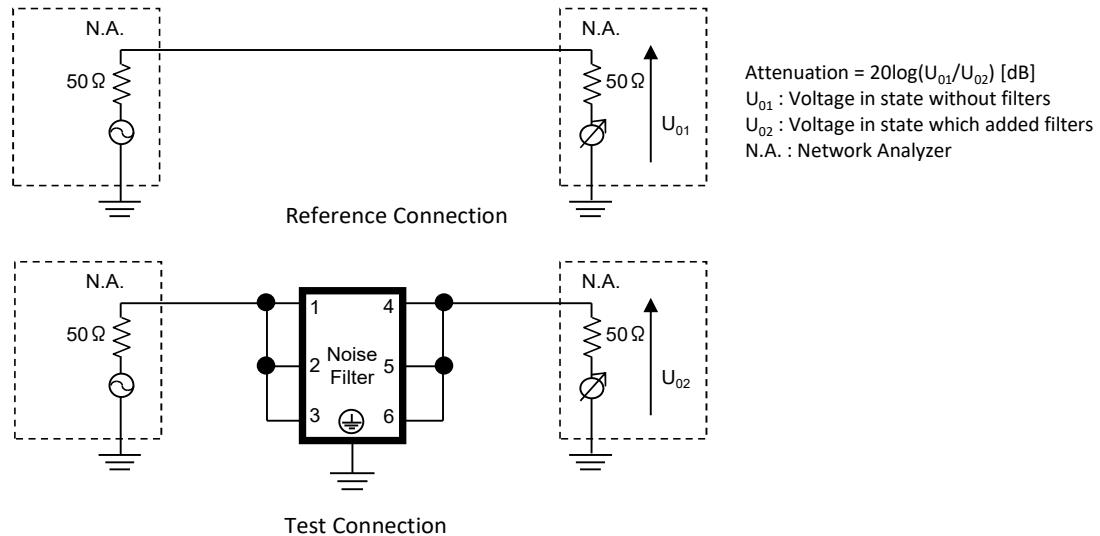


Figure A - 2 Common mode attenuation measurement

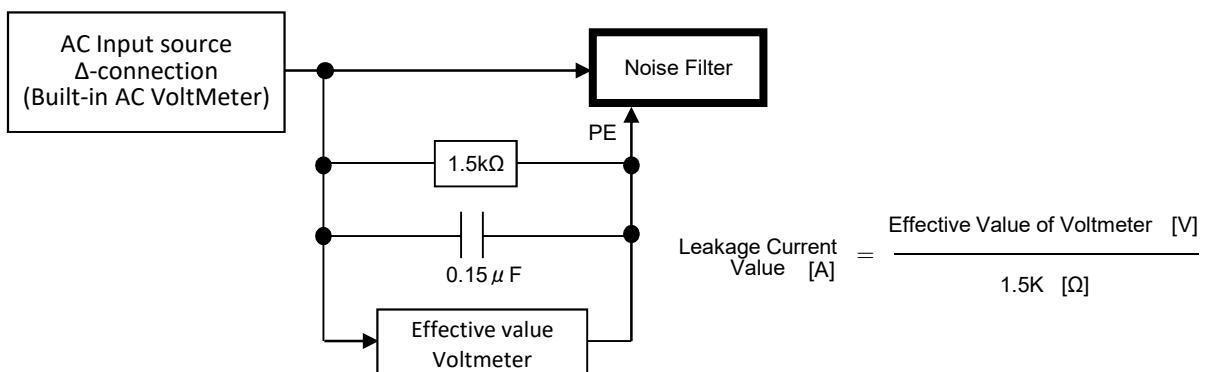


Figure B - 1 Leakage current measurement (UL60939 Δ -connection)

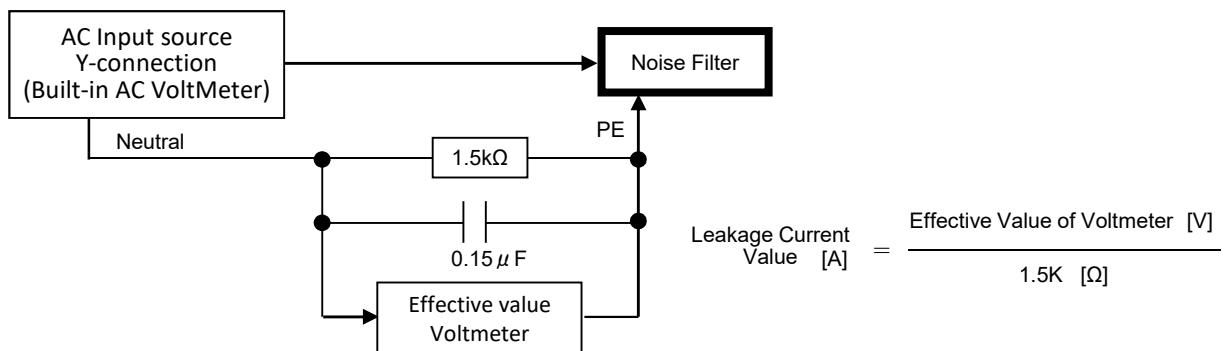


Figure B - 2 Leakage current measurement (UL60939 Y-connection)