



PBW50F EMI/EMS Test result

July 4, 2005
Design engineering dep.

Approved : *K. Higashimura*

Prepared : *Reishi Goshigama*

No.	Test item	Conditions	Conditions of Acceptability	Result
1	Line conduction	(1) Rated input(AC100V,120V,230V) (2) Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$	(1)Meets the undermentioned standard. FCC Part15 classB , VCCI classB CISPR22 classB , EN55022-B, EN55011-B	OK
2	Radiated emission	(1) Rated input(AC100V,120V,230V) (2) Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$	(1)Meets the undermentioned standard. FCC Part15 classB , VCCI classB CISPR22 classB , EN55022-B, EN55011-B	OK
3	Harmonic current (EN61000-3-2)	(1) Rated input (AC100V,230V) (2) Load 0 - Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$	(1)Meets the undermentioned standard. EN61000-3-2 classA	OK
4	Static electricity immunity test (EN61000-4-2)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$ (4) Contact discharge voltage 8[kV] (Level 4)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
5	Radiated, radio-frequency, electromagnetic field immunity test (EN61000-4-3)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$ (4)Testing field strength 10[V/m] (Level 3)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
6	Electrical fast transient/ burst immunity test (EN61000-4-4)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$ (4) Test peak voltage 4[kV] (Level 4)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
7	Surge immunity test (EN61000-4-5)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$ (4) Test voltage Line to line 2[kV] (Level 3) Line to earth 4[kV] (Level 4)	(1)The power supply is not stop (2)Circuit does not malfunction. (3)No abnormality of the insulation destruction etc. (4)Parts are no damaged.	OK
8	Immunity to conducted disturbances, induced by radio-frequency fields (EN61000-4-6)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$ (4) Voltage level (e.m.f.) 10[V] (Level 3)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
9	Power frequency magnetic field immunity test (EN61000-4-8)	(1) Rated input (AC230V) (2) Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$ (4) Magnetic field 30A/m (Level 4)	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK
10	Voltage dips, short interruptions and voltage variations immunity test (EN61000-4-11)	(1) Rated input (AC230V) • 30% reduction at 10mS min. • 60% reduction at 100mS min • 95% reduction at 5S min. • $\pm 10\%$ variation at 15 minutes (2) Rated load (3) Ambient temp. $25 \pm 10^{\circ}\text{C}$	(1)No protection circuit failure. (2)No output voltage drop with control circuit failure. (3)No any other function failure	OK


DATA SHEET

Date		09-Mar-05	
Model	PBW50F-15	Temp.	25 degreeC
Test	EMI Line conduction & Radiated emission	Humid.	45 %RH
		Tested by	N.Kawataka

LINE CONDUCTION

Model Name : PBW50F-15
 Model No. :
 Serial No. :
 Points : 5
 Detector : PEAK/QP/Ave.
 Line Mode : VA/VB
 Power Supply : AC 230V 50Hz
 Limit1 : [EN 55022] Class B(QP)
 Limit2 : [EN 55022] Class B(Ave.)

Temp. : 25 degreeC
 Humi. : 45 %
 Date : 2005/3/9 10:13
 Test Equip. : R3132,ESPC
 Load Line : 150 mm
 Comment :

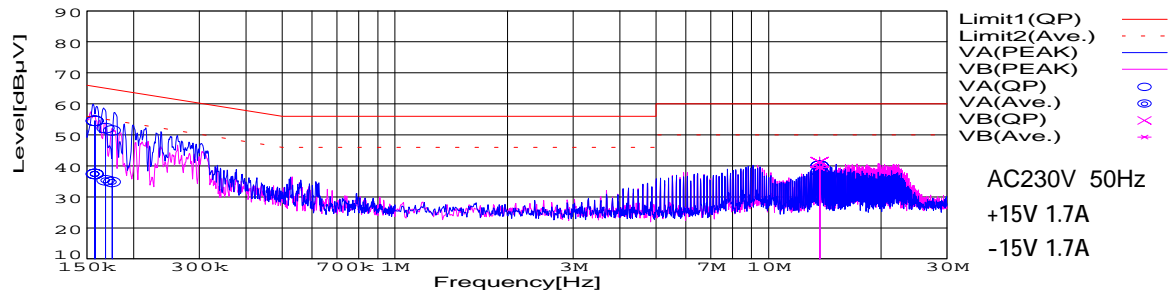


Frequency [MHz]	Meter Reading (Ave.) [dBuV]	Meter Reading (QP) [dBuV]	Factor [dB]	Level(Ave.) [dBuV]	Level(QP) [dBuV]	Line	Limit(Ave.) [dBuV]	Limit(QP) [dBuV]	Margin(Ave.) [dB]	Margin(QP) [dB]
0.1576	27.4	44.5	10	37.4	54.5	VA	55.6	65.6	18.2	11.1
0.1684	25.3	42.1	10	35.3	52.1	VA	55	65	19.7	12.9
0.1753	24.8	41.4	10	34.8	51.4	VA	54.7	64.7	19.9	13.3
13.6946	27.6	29.5	10.6	38.2	40.1	VA	50	60	11.8	19.9
13.6973	28.9	30.6	10.6	39.5	41.2	VB	50	60	10.5	18.8

RADIATED EMISSION

Model Name : PBW50F-15
 Model No. :
 Serial No. :
 Points : 5
 Detector : PEAK/QP
 Polarization : Hori. & Vert.
 Power Supply : AC 230V 50Hz
 Limit : [EN 55022] Class B<3m>

Temp. : 25 degreeC
 Humi. : 45 %
 Date : 2005/3/23 18:24
 Test Equip. : R3132,ESPC
 Load Line : 150 mm
 Comment :

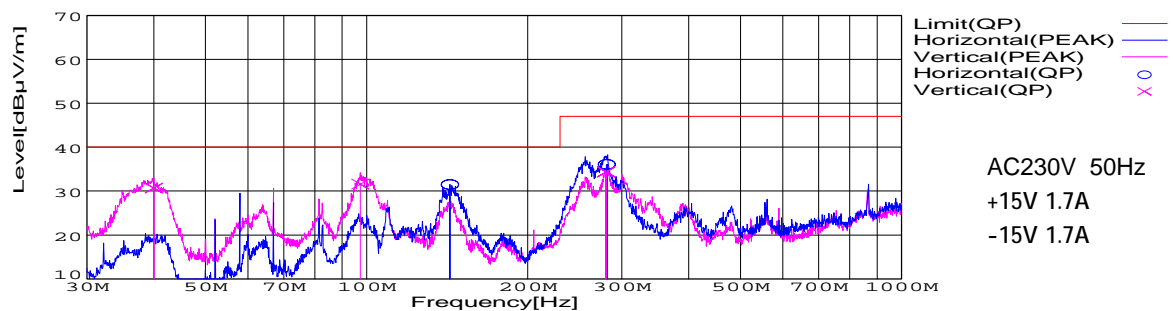

Frequency [MHz]	Meter Reading (QP) [dBuV]	Ant. Type	Antenna Factor [dB/m]	Cable & Preamp [dB]	Level(QP) [dBuV/m]	Angle [°]	Height [cm]	Polar.	Limit [dBuV/m]	Margin [dB]
143.212	45.4	BL	10.7	-24.6	31.5	193	160	Hori.	40	8.5
281.277	47	BL	12.4	-23.3	36.1	112	113	Hori.	47	10.9
40.038	44.1	BL	12.6	-26	30.7	351	101	Vert.	40	9.3
97.326	47.7	BL	9	-25.1	31.6	23	101	Vert.	40	8.4