

# TEST DATA OF TAC-250-□□□

## Noise Filter

March. 19. 2009

Approved by : Toshio Watanabe Toshio Watanabe Design Manager

Prepared by : Yuichi Uozu Design Engineer

COSEL CO.,LTD.





## CONTENTS


1.Attenuation Characteristics .....	1
2.Leakage Current .....	3
3.Figure of Testing Circuitry .....	4

(Final Page 4)

COSEL

Model	TAC-250-□□□
Item	Attenuation Characteristics
Object	—

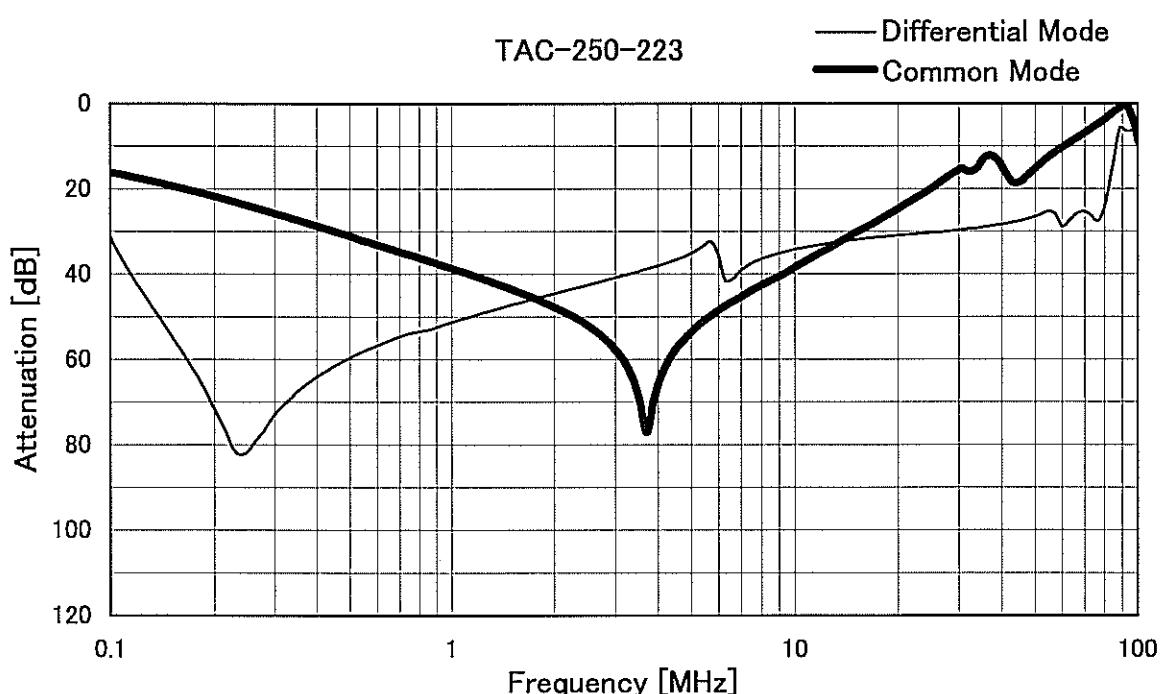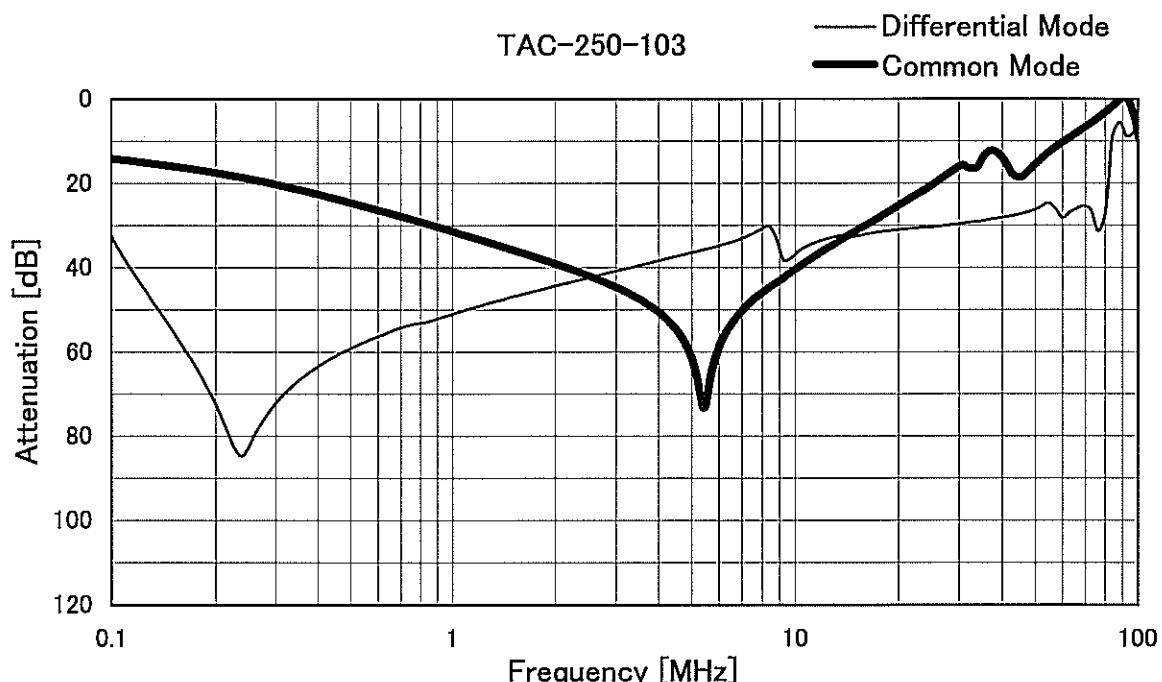Temperature 25°C  
Testing Circuitry Figure A

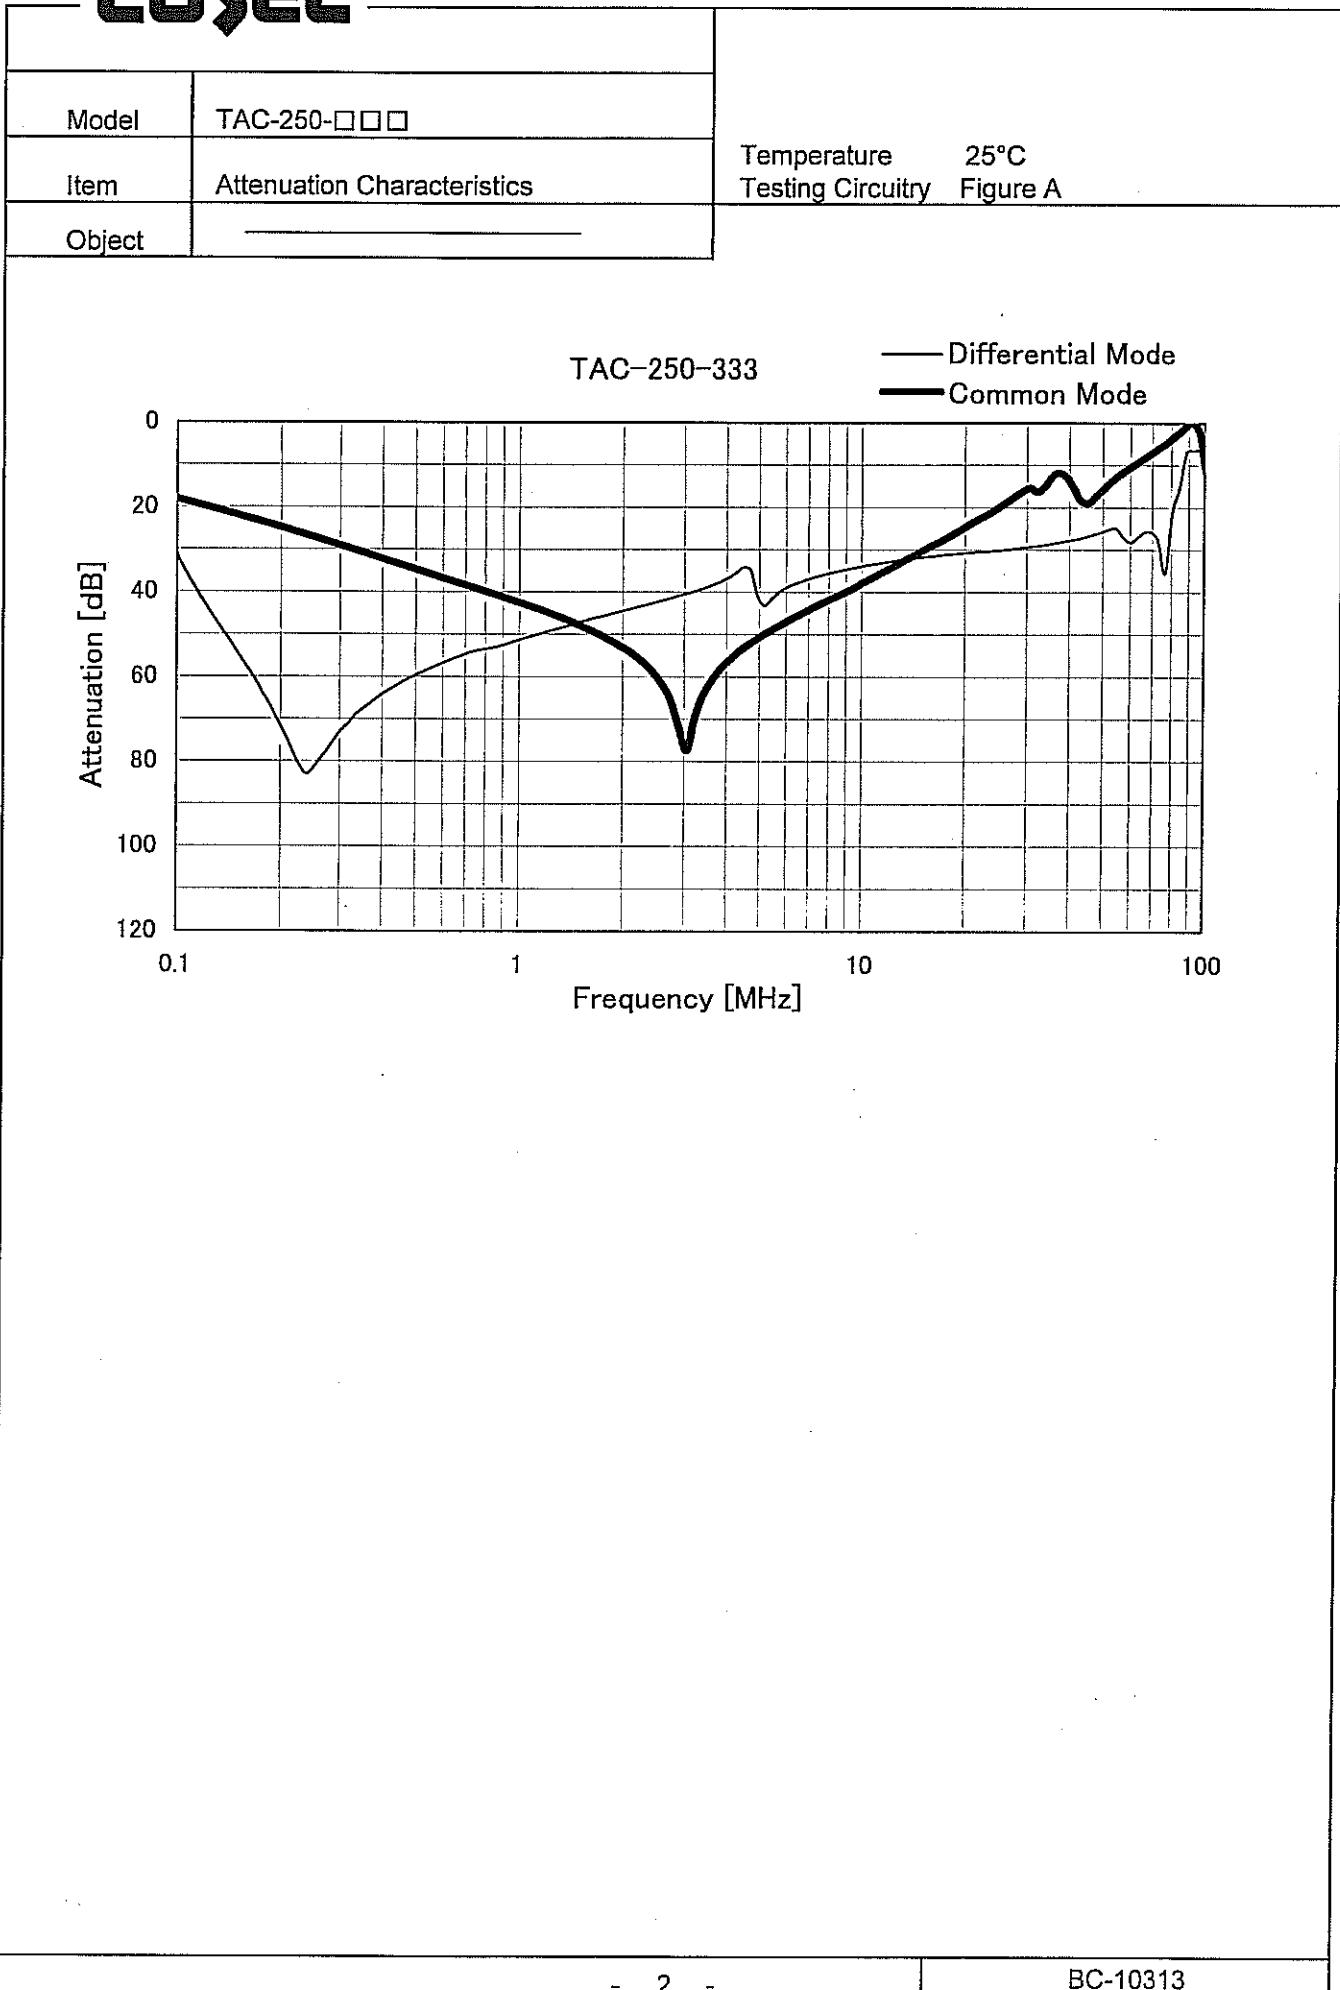**COSEL**



Model	TAC-250-□□□	Temperature	25°C
Item	Leakage Current	Testing Circuitry	Figure B
Object	_____		

## 1. Results

[mA]

Model	Standards	Input Volt.					Note
		200 [V]	250 [V]	400 [V]	480 [V]	500 [V]	
TAC-250-103	UL1283	0.62	0.77	1.3	1.5	1.6	
TAC-250-223	UL1283	1.4	1.7	2.8	3.3	3.4	
TAC-250-333	UL1283	2.1	2.6	4.1	4.9	5.2	

## 2. Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

COSEL

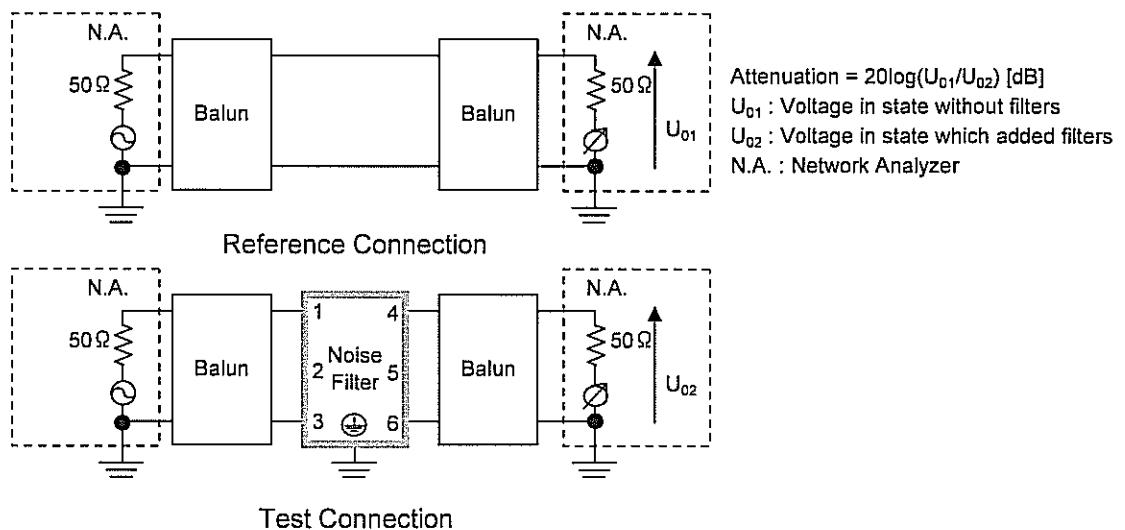


Figure A - 1 Differential mode attenuation measurement

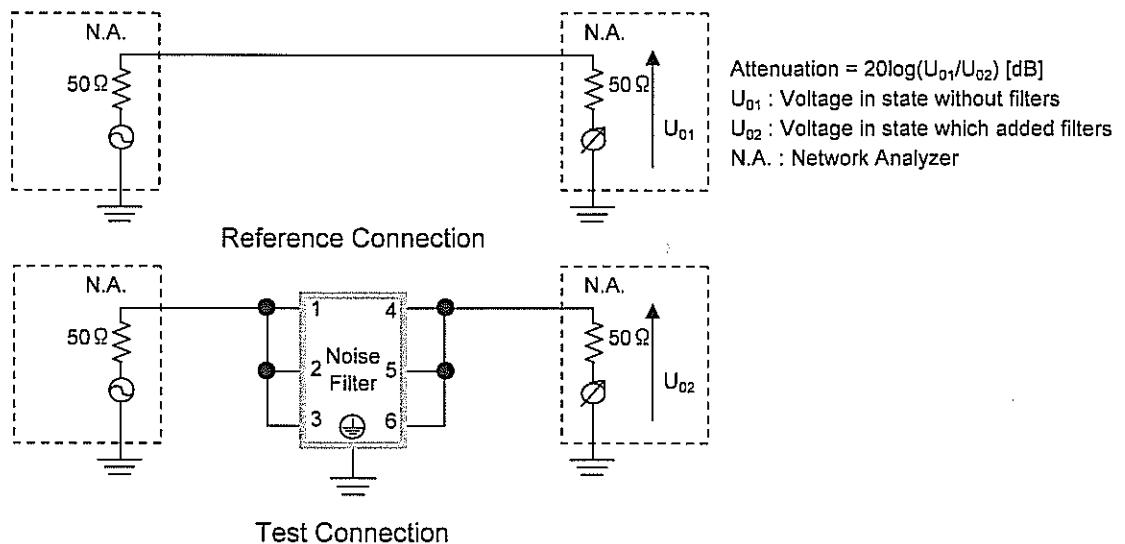


Figure A - 2 Common mode attenuation measurement

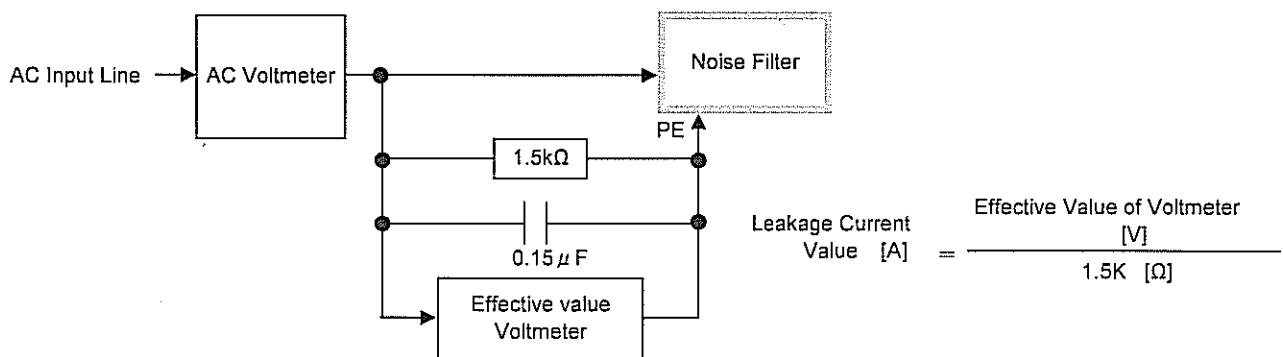


Figure B Leakage current measurement ( UL1283 )