

TEST DATA OF TAH-06-□□□

Noise Filter

Sep. 11, 2017

Approved by :

Tadayuki Noda
Tadayuki Noda

Design Manager

Prepared by :

Issei Okuno
Issei Okuno


Design Engineer


COSEL CO.,LTD.



CONTENTS

1.Attenuation Characteristics	1
2.Leakage Current	3
3.Figure of Testing Circuitry	4
(Final Page 4)	

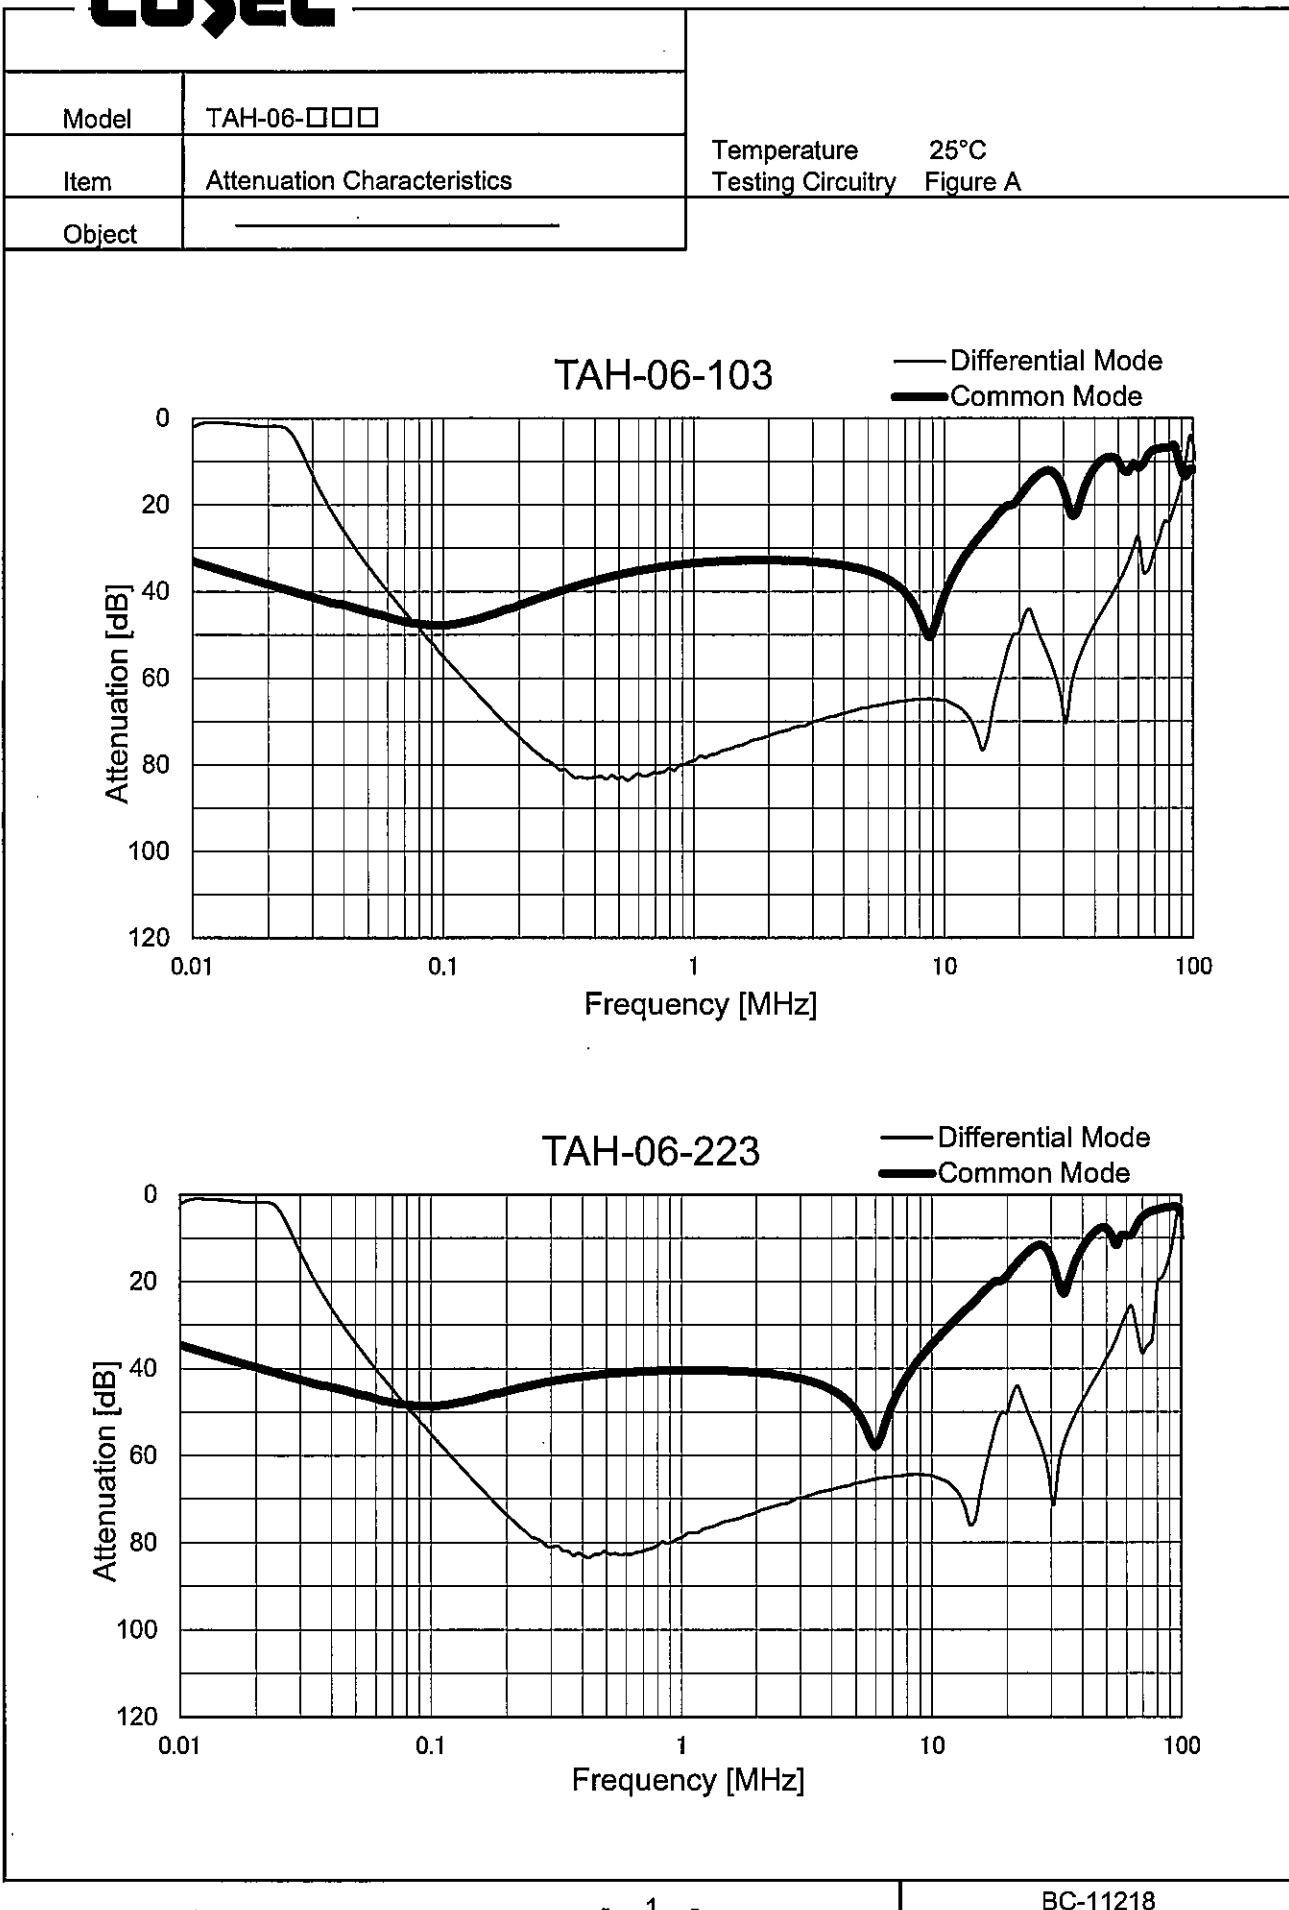COSEL

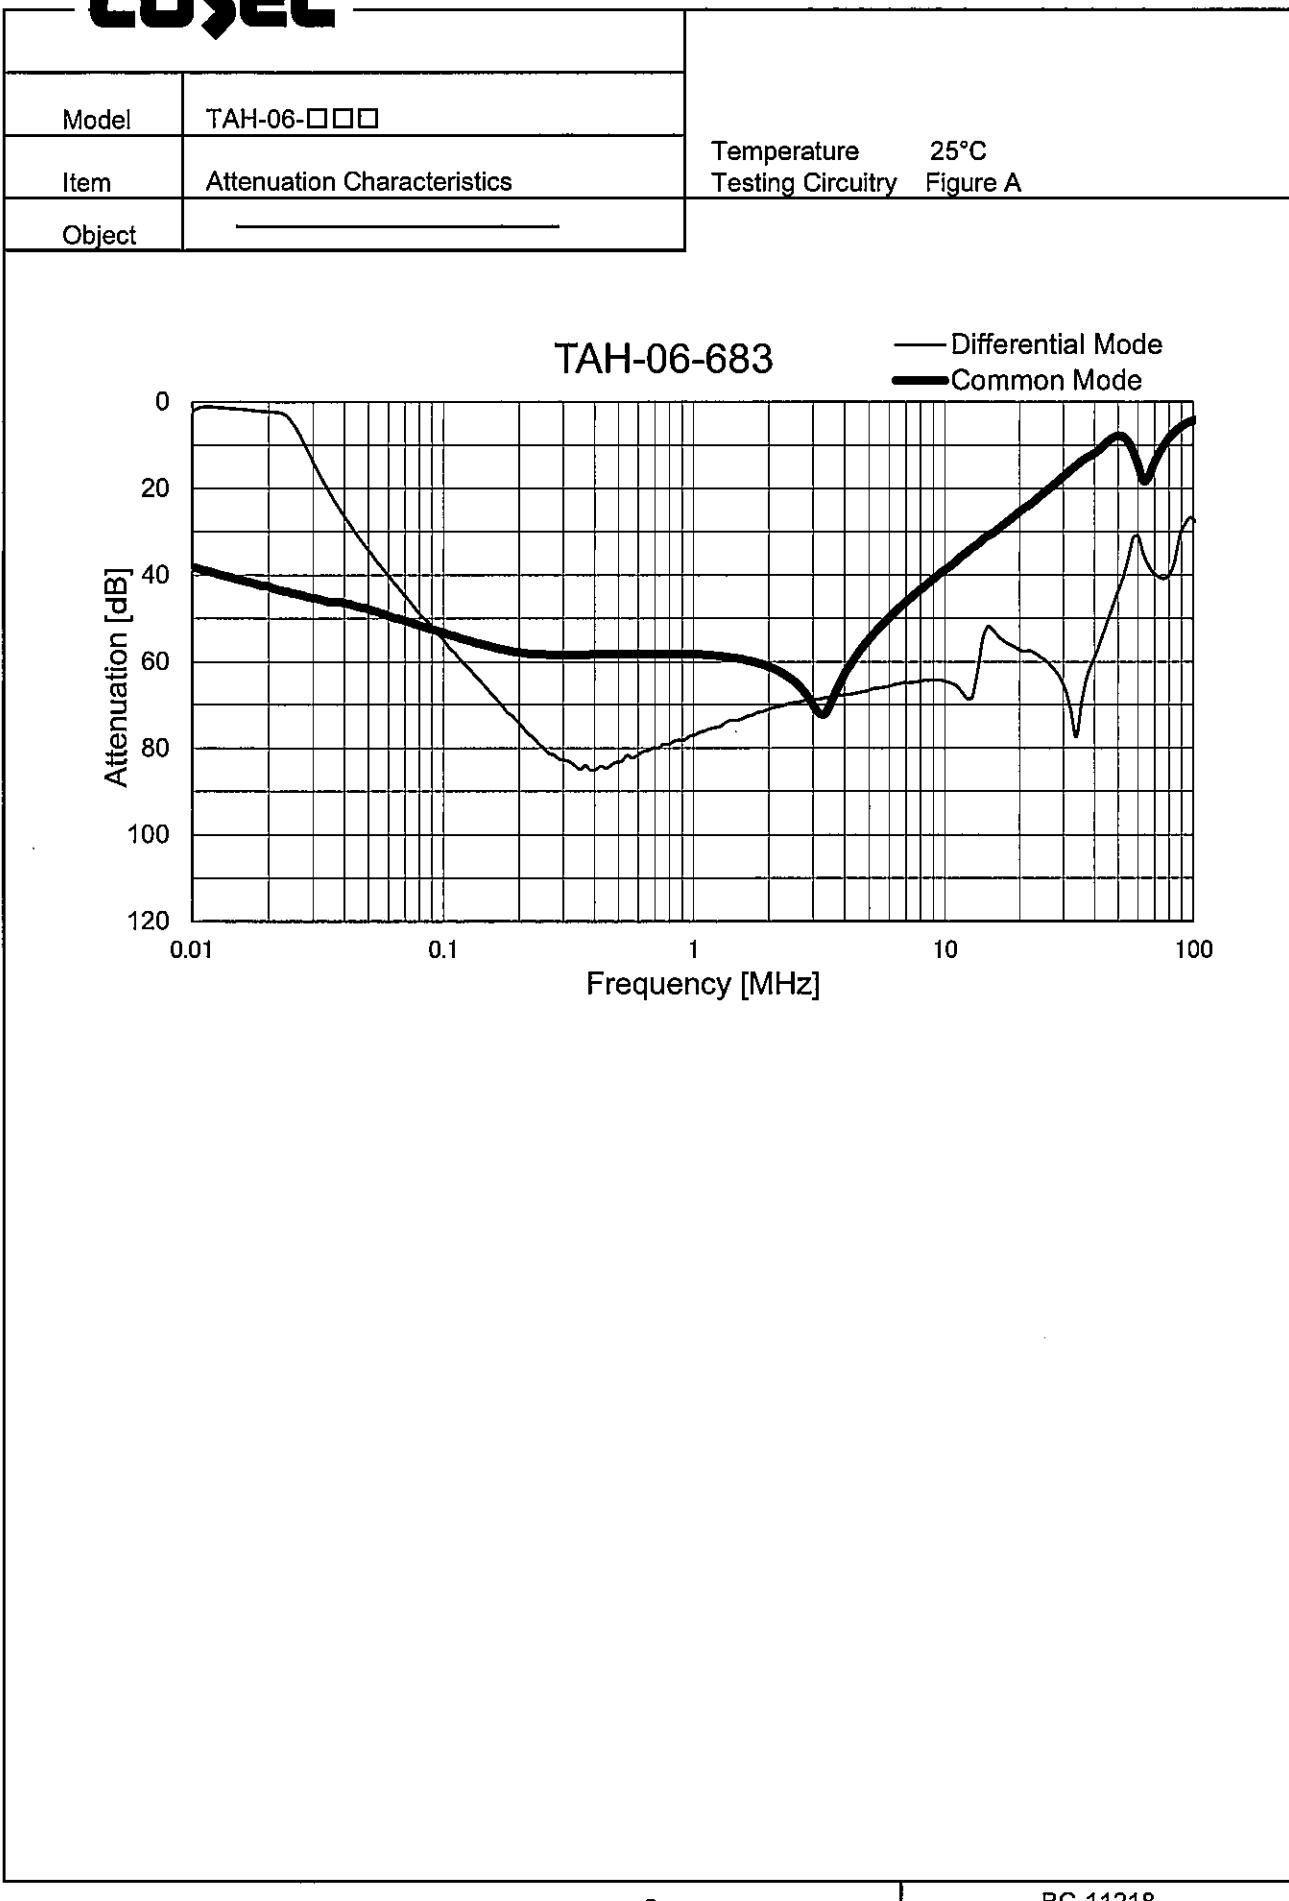COSEL



Model	TAH-06-□□□	Temperature	25°C
Item	Leakage Current	Testing Circuitry	Figure B
Object	_____		

1. Results

[mA]

Model	Standards	Input Volt.				Note
		200[V]	250[V]	400[V]	500[V]	
TAH-06-103	UL1283	0.23	0.28	0.45	0.57	
TAH-06-223	UL1283	0.52	0.65	1.0	1.3	
TAH-06-683	UL1283	1.4	1.8	2.8	3.6	

2. Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

COSEL

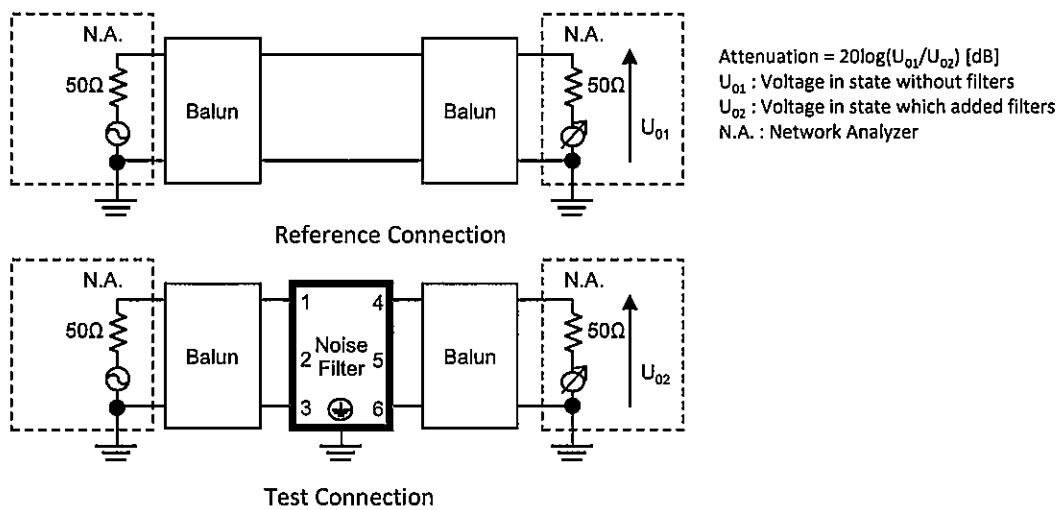


Figure A - 1 Differential mode attenuation measurement

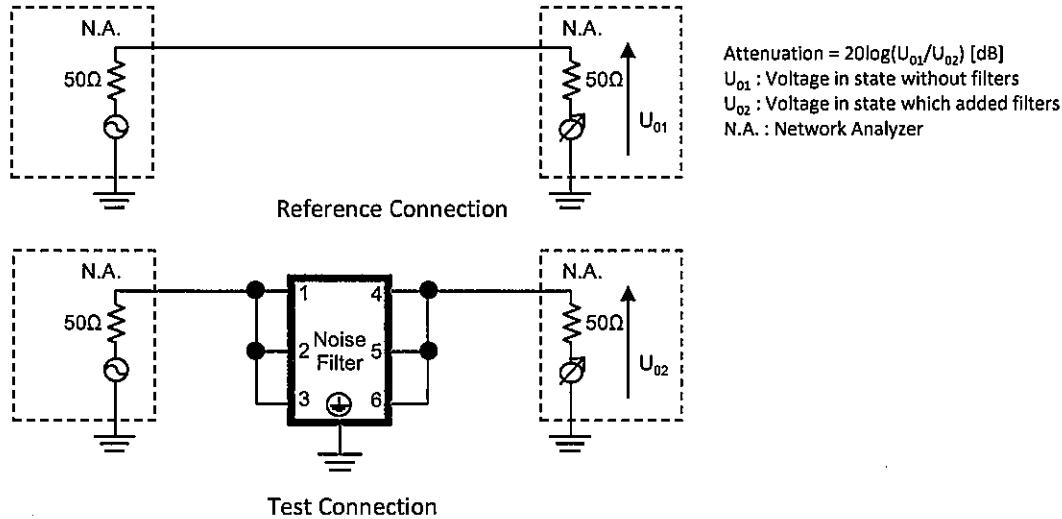


Figure A - 2 Common mode attenuation measurement

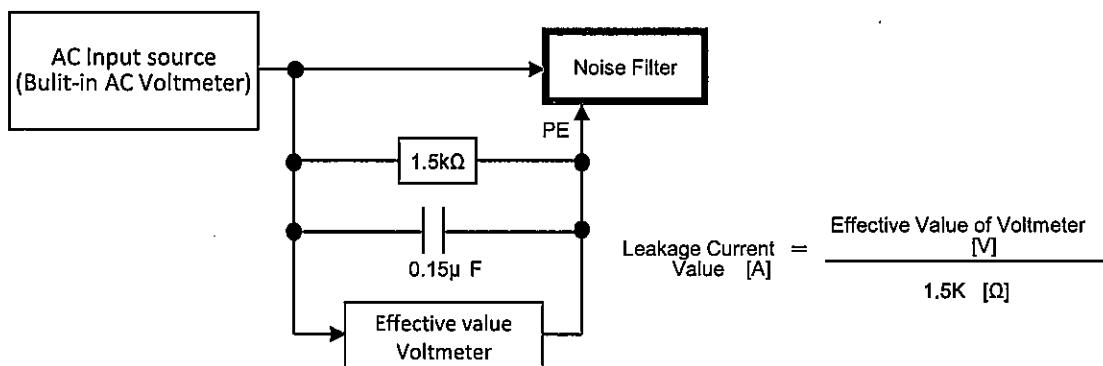


Figure B Leakage current measurement (UL1283)