

TEST DATA OF TAH-100-□□□-U

Noise Filter

May. 20. 2016

Approved by : Tadayuki Noda Tadayuki Noda Design Manager

Prepared by : Shiro Gotani Design Engineer
Shiro Gotani


COSEL CO.,LTD.




CONTENTS

1.Attenuation Characteristics	1
2.Leakage Current	3
3.Figure of Testing Circuitry	4
(Final Page 4)	

COSEL

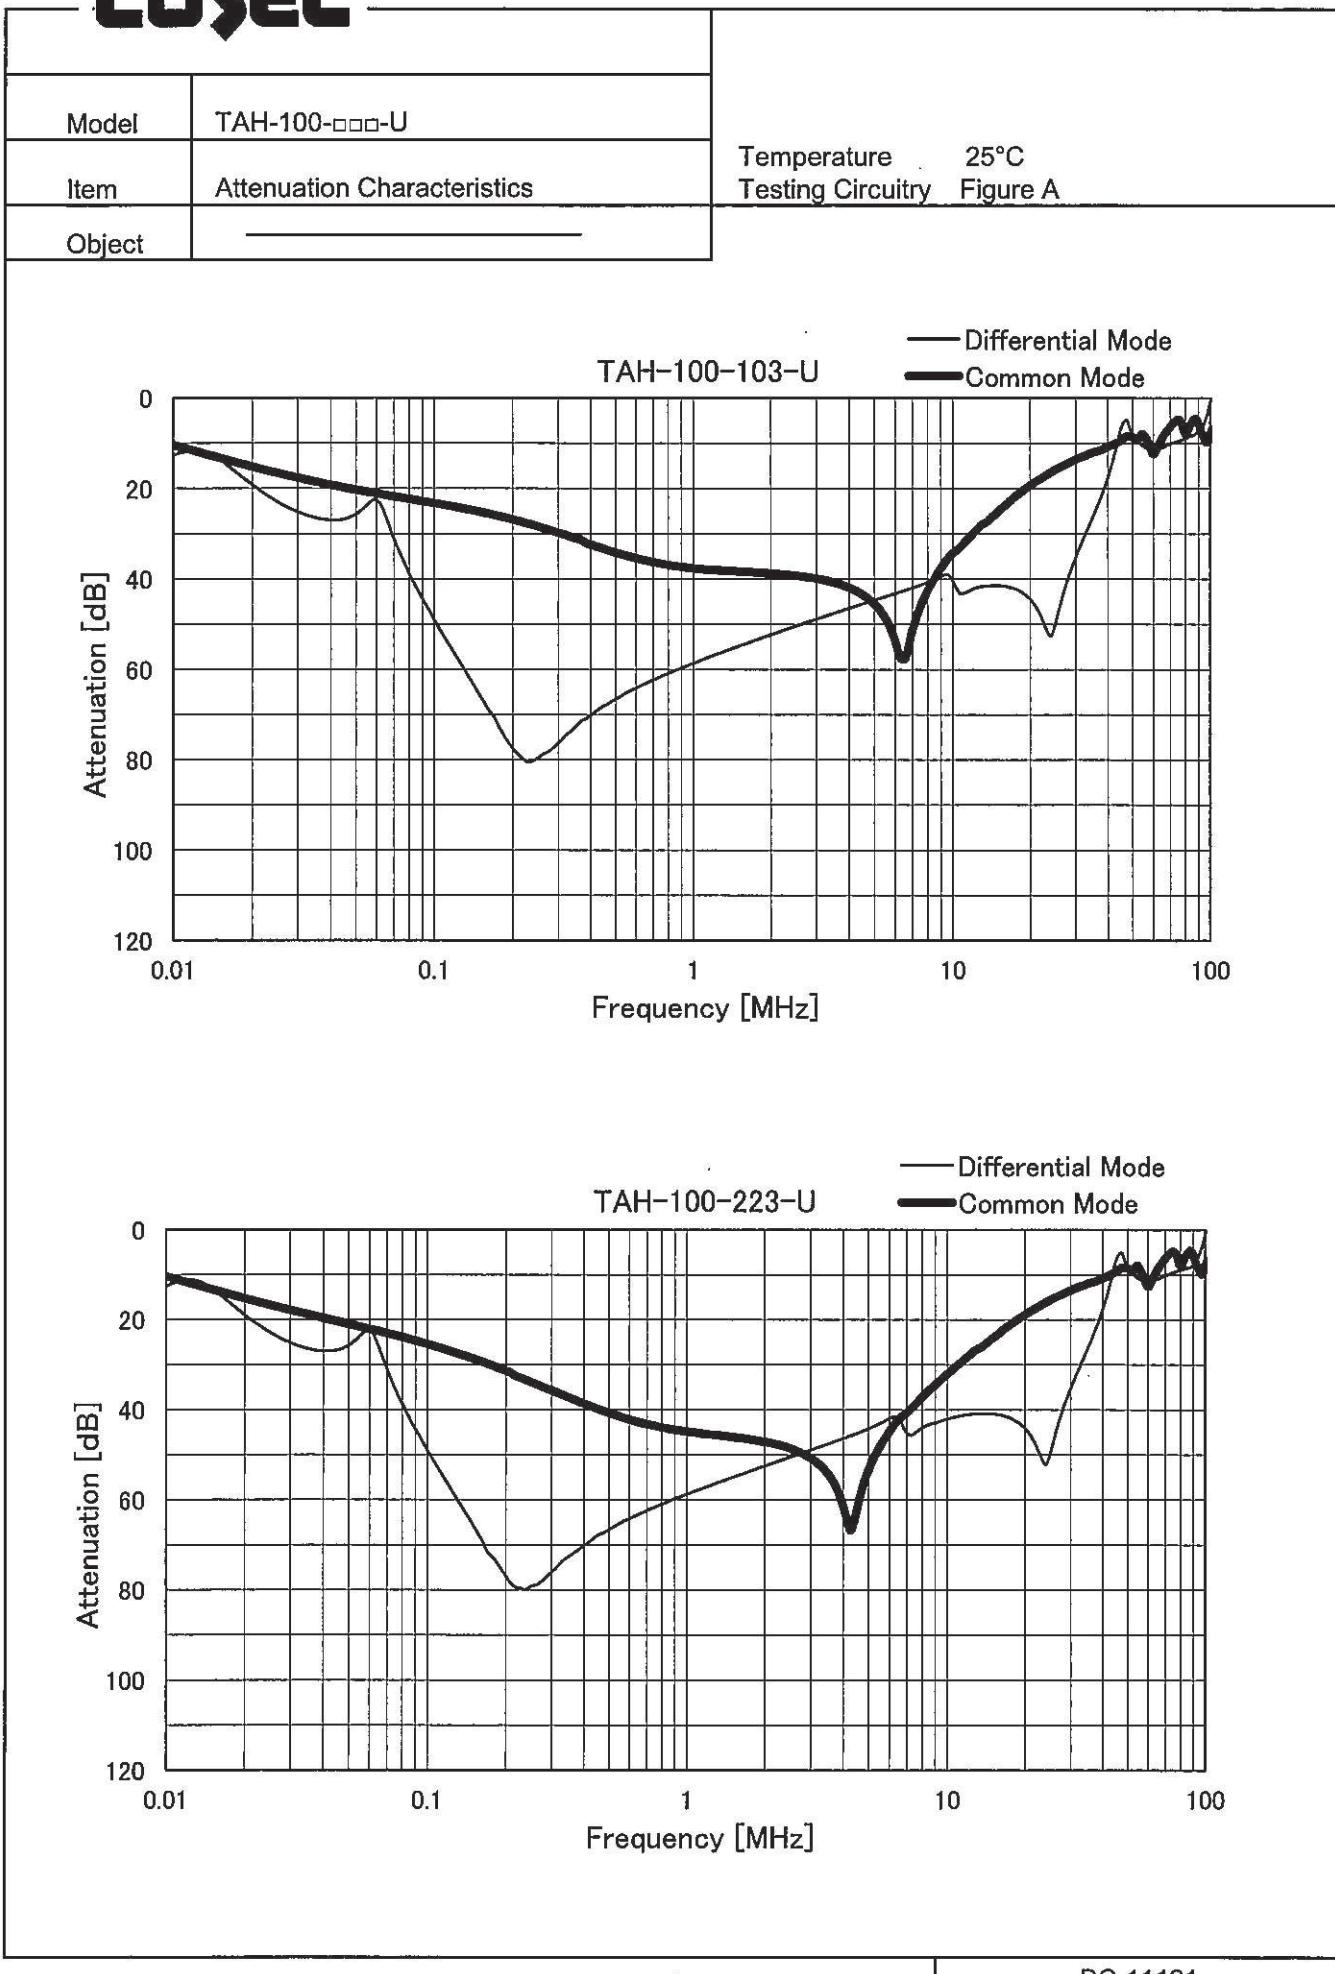

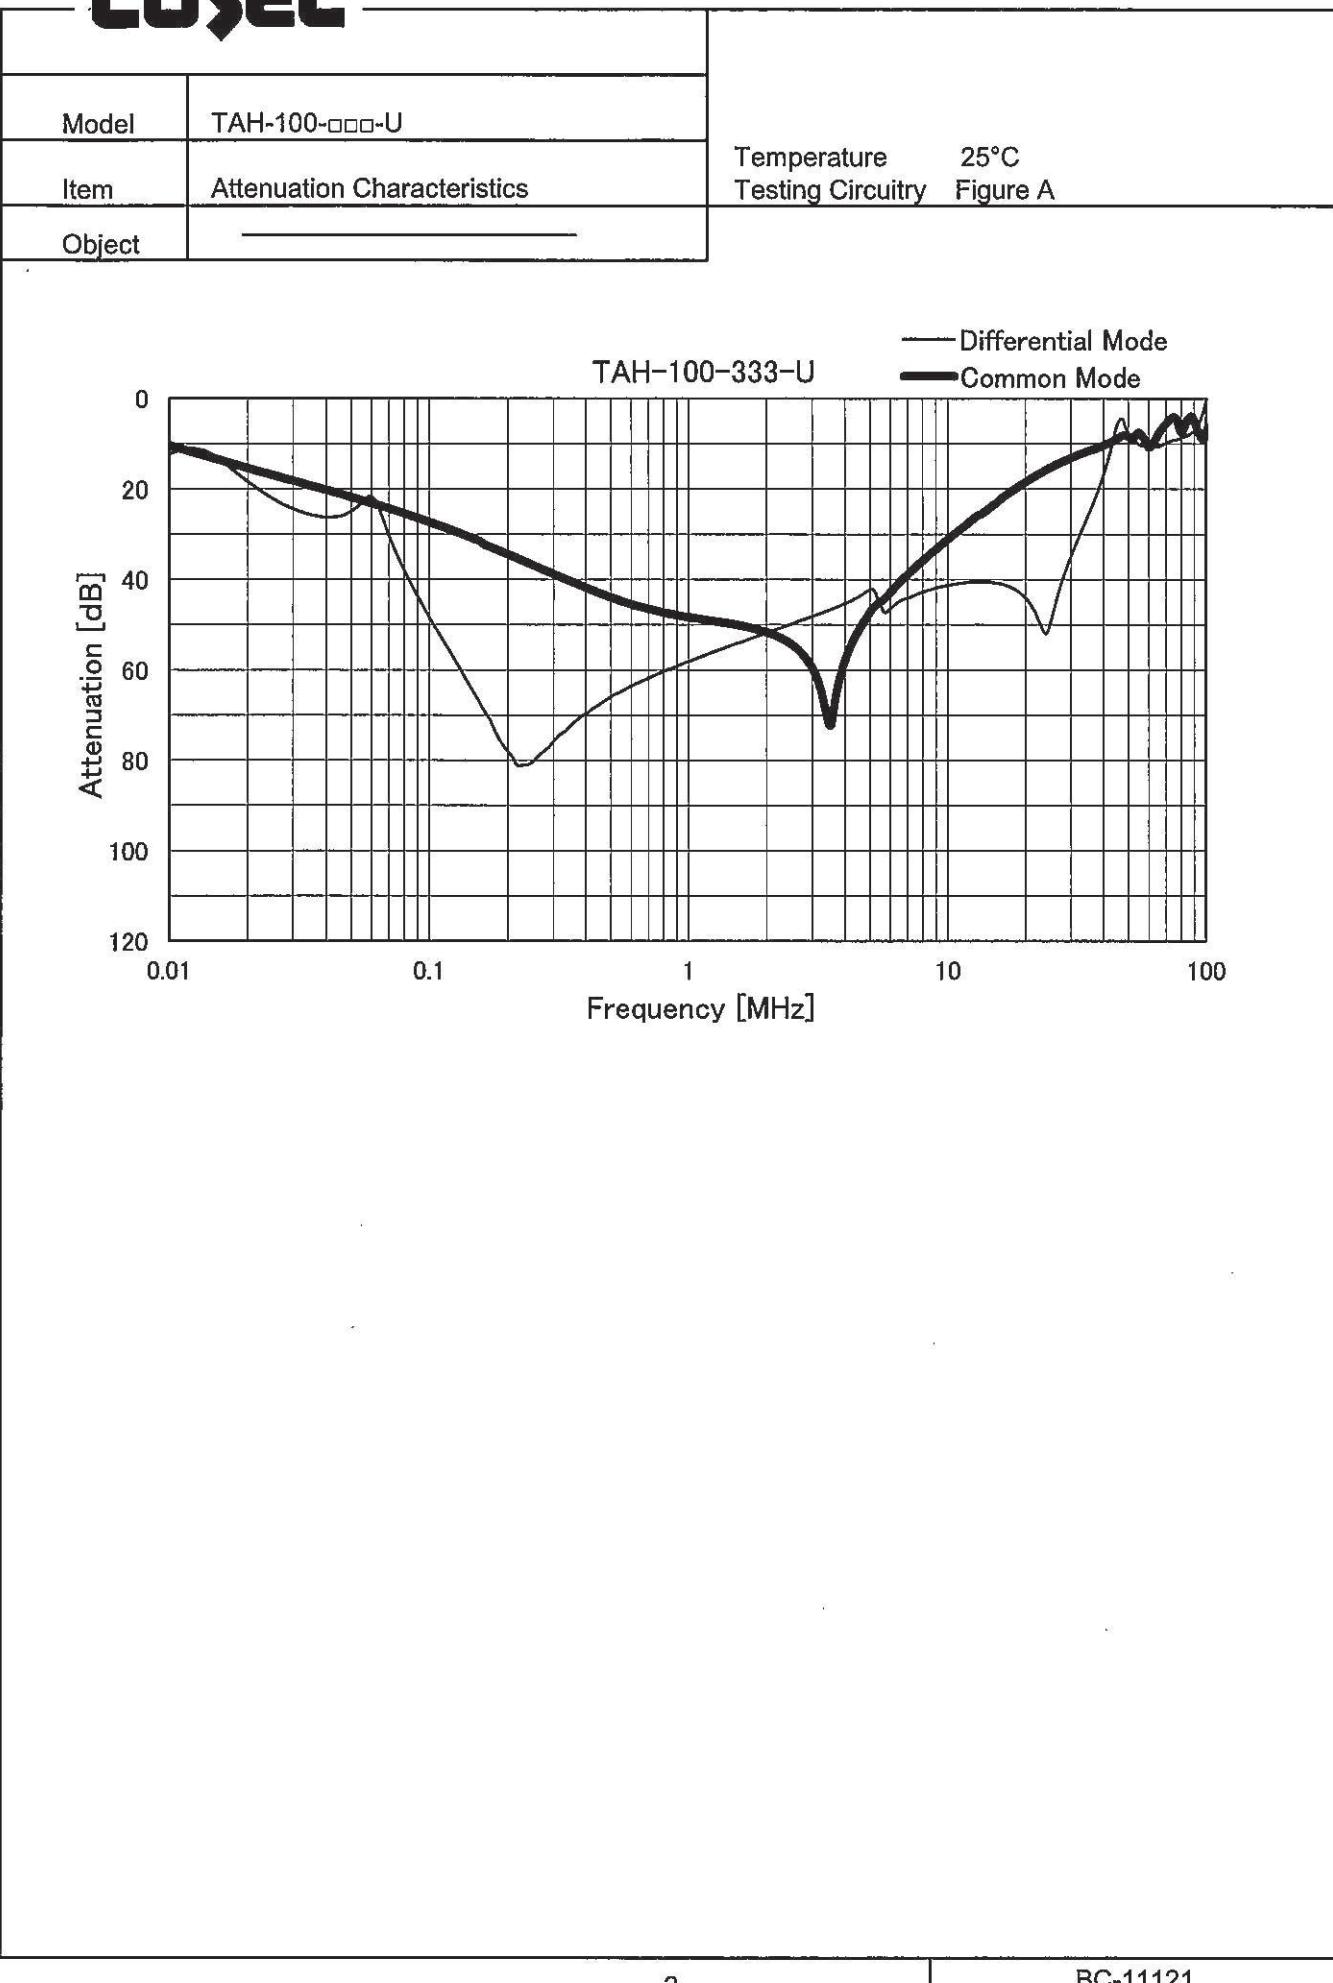COSEL



Model	TAH-100-□□□-U	Temperature Testing Circuitry	25°C Figure B
Item	Leakage Current		
Object	<hr/>		

1. Results

[mA]

Model	Standards	Input Volt.					Note
		200 [V]	250 [V]	400 [V]	480 [V]	500 [V]	
TAH-100-103-U	UL1283	0.65	0.78				
TAH-100-223-U	UL1283	1.49	1.80				
TAH-100-333-U	UL1283	1.95	2.45				

2. Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

coSEL

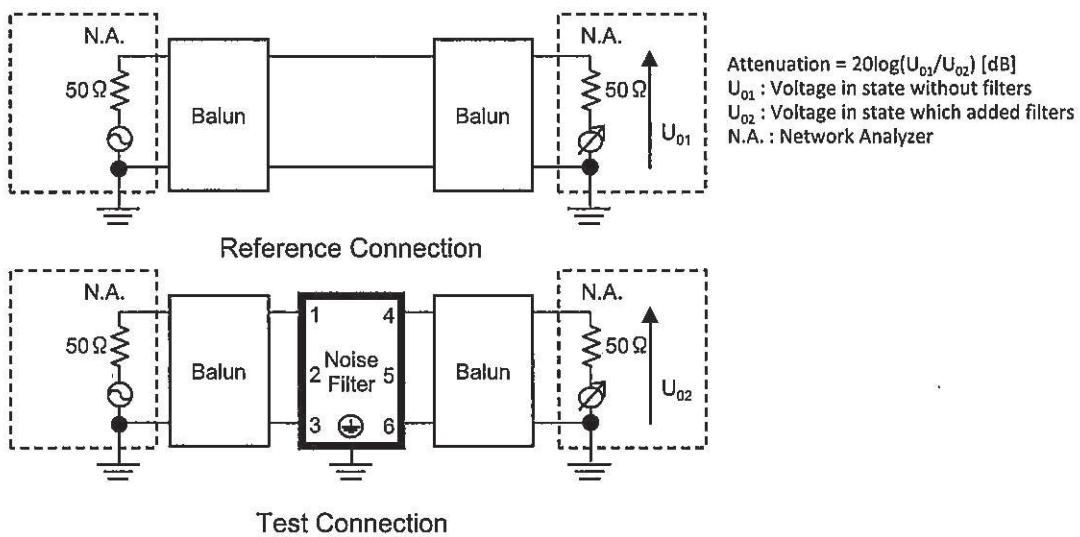


Figure A - 1 Differential mode attenuation measurement

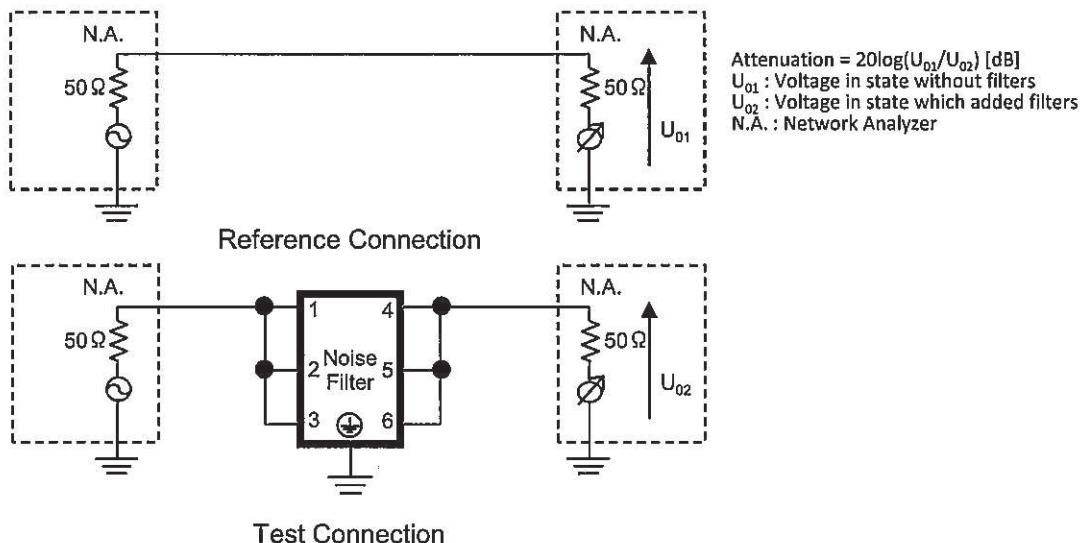


Figure A - 2 Common mode attenuation measurement

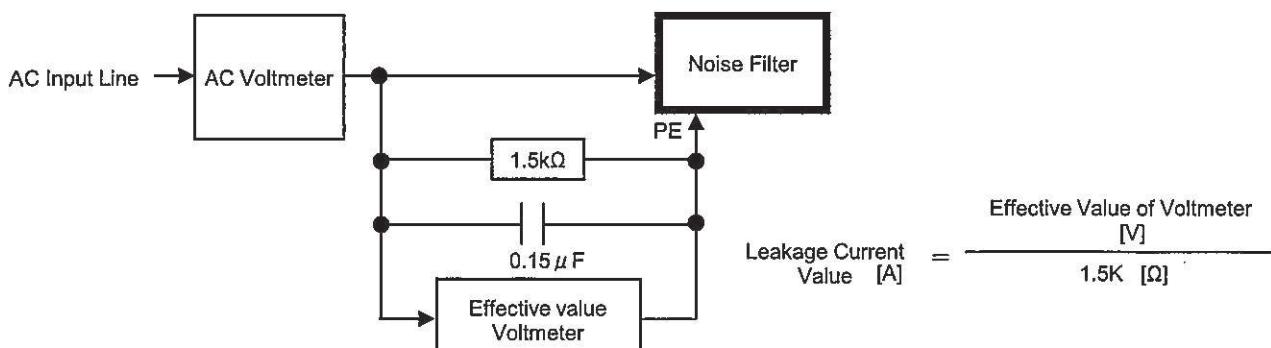


Figure B Leakage current measurement (UL1283)