

TEST DATA OF TAH-50-□□□

Noise Filter

May. 20. 2016

Approved by : Tadayuki Noda
Tadayuki Noda Design Manager

Prepared by : Shiro Gotani
Shiro Gotani Design Engineer


COSEL CO.,LTD.




CONTENTS

| | |
|-------------------------------------|---|
| 1.Attenuation Characteristics | 1 |
| 2.Leakage Current | 3 |
| 3.Figure of Testing Circuitry | 4 |

(Final Page 4)

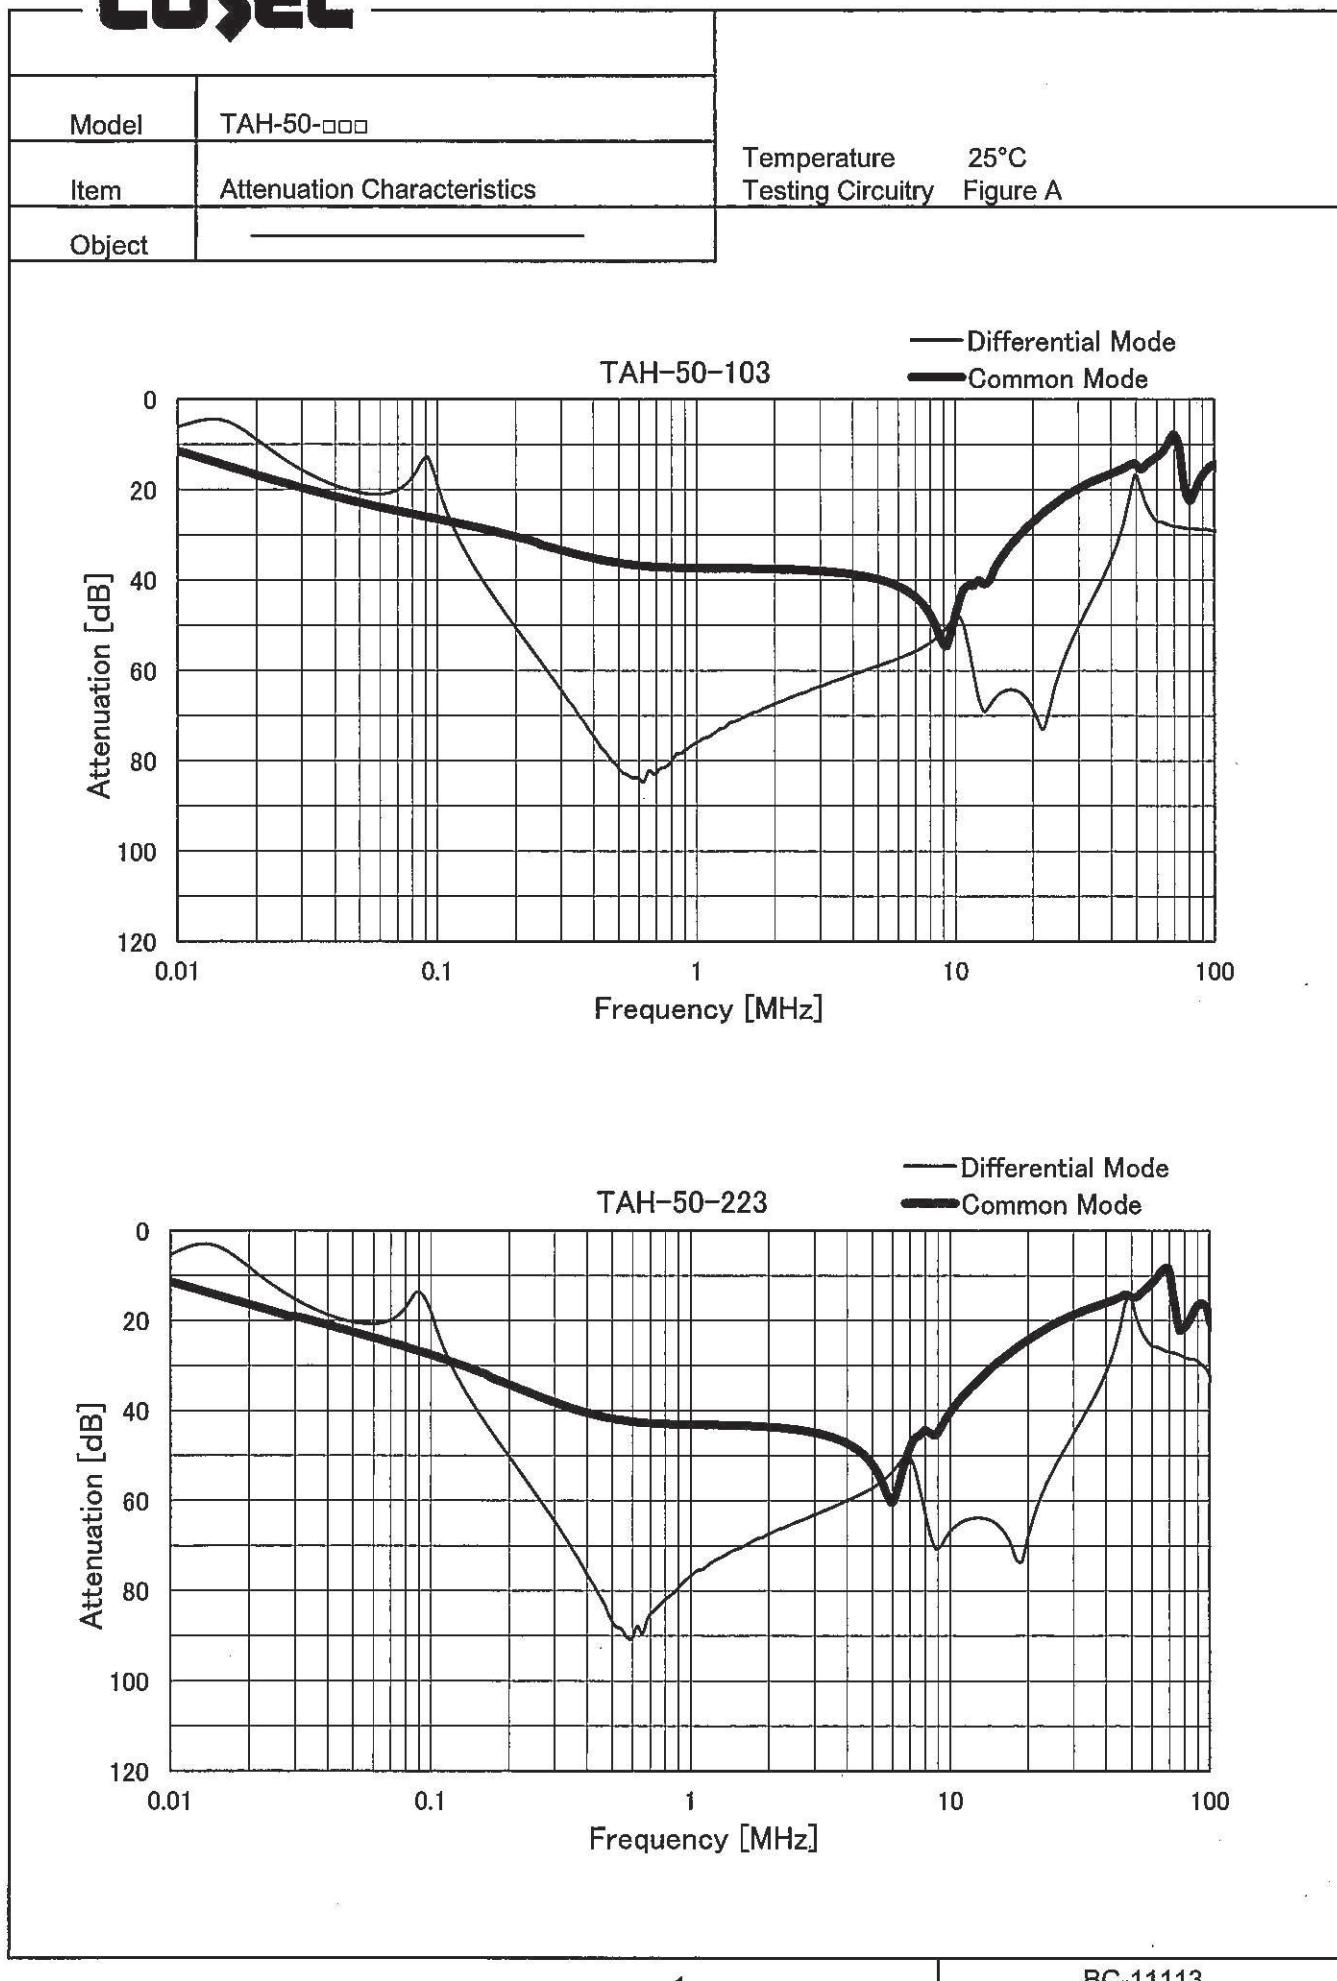COSEL

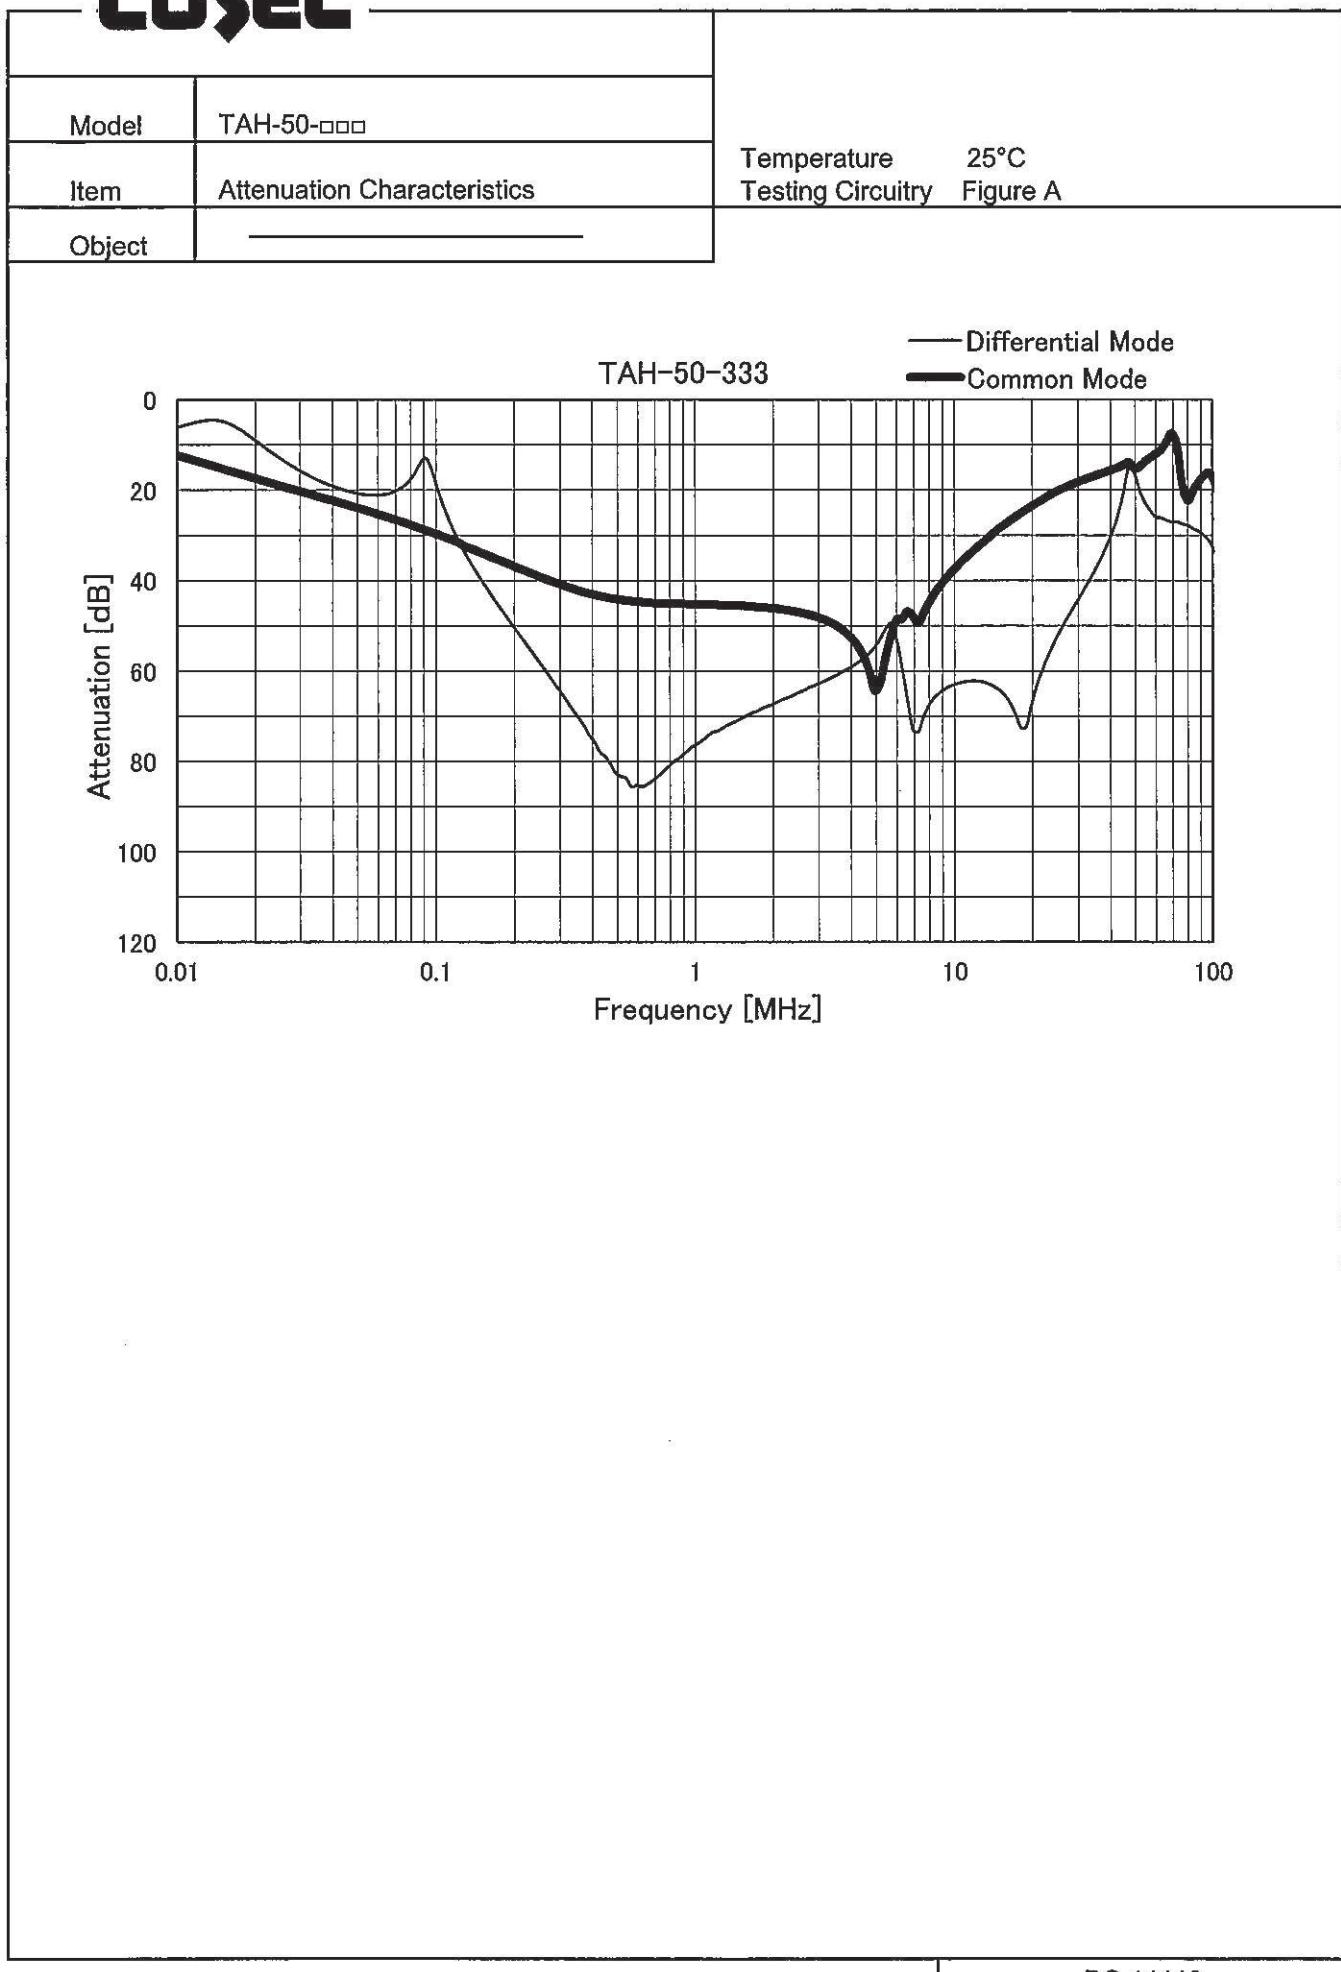COSEL



| | | | | |
|--------|-----------------|----------------------------------|------------------|--|
| Model | TAH-50-□□□ | Temperature Testing Circuitry | 25°C Figure B | |
| Item | Leakage Current | | | |
| Object | _____ | | | |

1. Results

[mA]

| Model | Standards | Input Volt. | | | | | Note |
|------------|-----------|-------------|---------|---------|---------|---------|------|
| | | 200 [V] | 250 [V] | 400 [V] | 480 [V] | 500 [V] | |
| TAH-50-103 | UL1283 | 0.65 | 0.78 | 1.30 | 1.50 | 1.55 | |
| TAH-50-223 | UL1283 | 1.49 | 1.80 | 2.80 | 3.45 | 3.50 | |
| TAH-50-333 | UL1283 | 1.95 | 2.45 | 3.85 | 4.60 | 4.90 | |

2. Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

coSEL

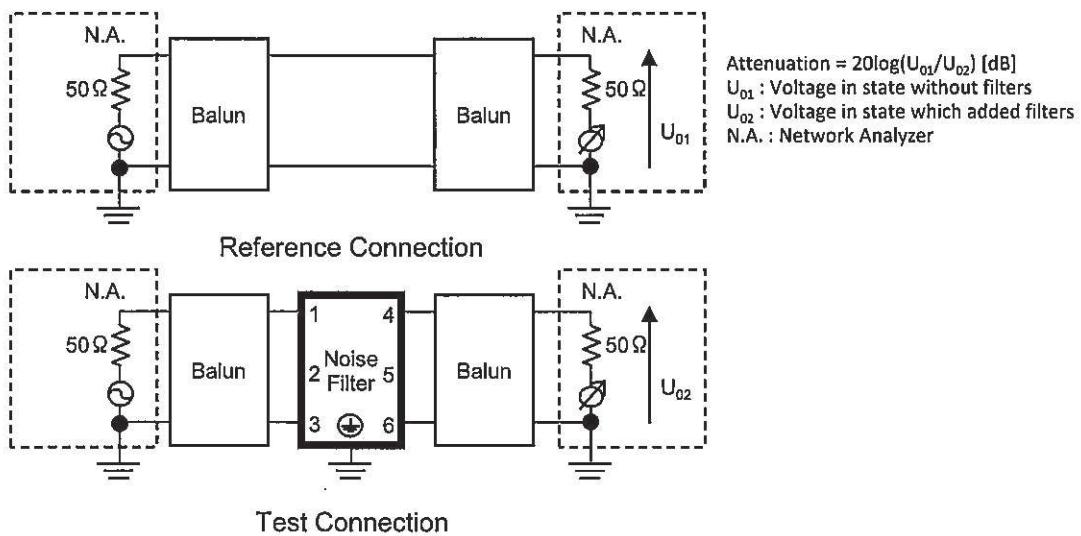


Figure A - 1 Differential mode attenuation measurement

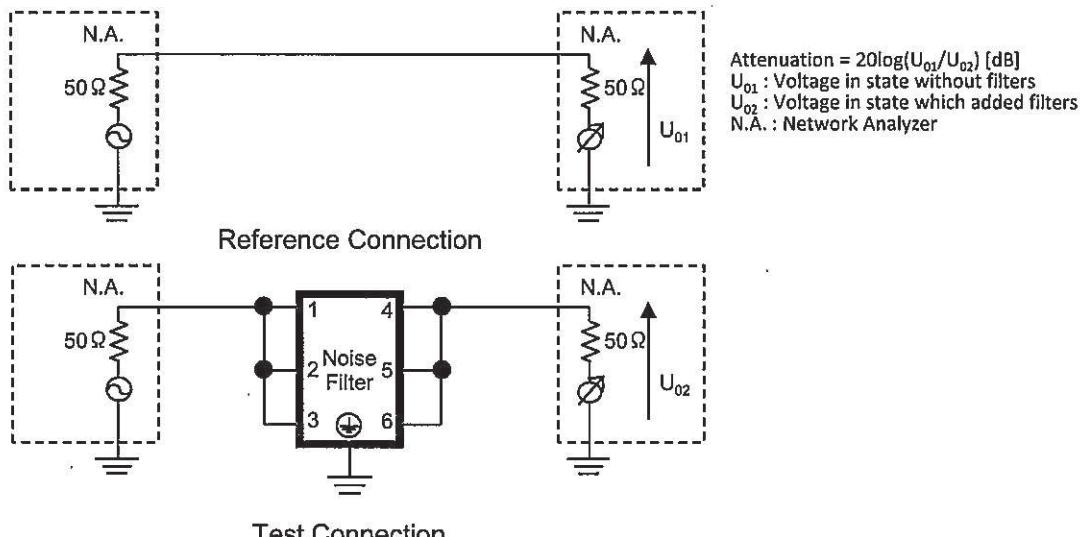


Figure A - 2 Common mode attenuation measurement

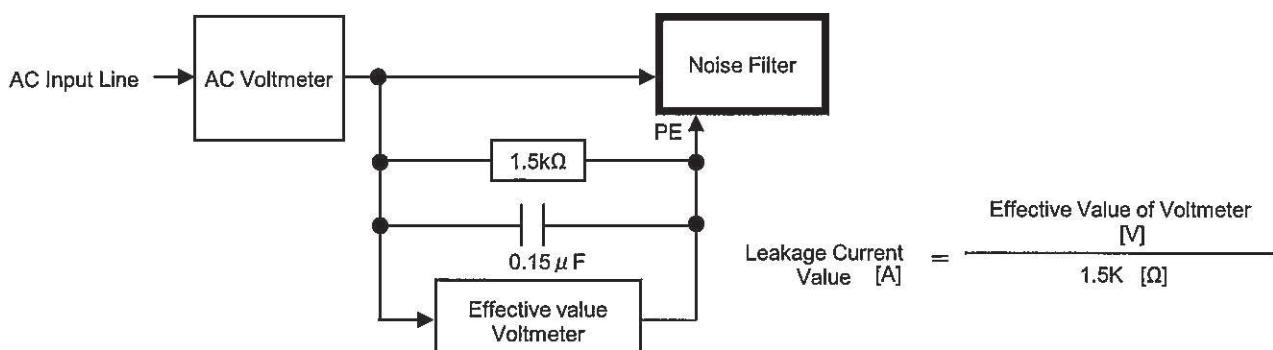


Figure B Leakage current measurement (UL1283)