



TEST DATA OF TBC-150-□□□

Noise Filter

June. 20. 2008

Approved by : Toshio Watanabe
Toshio Watanabe

Design Manager

Prepared by : Tadayuki Noda
Tadayuki Noda

Design Engineer

COSEL CO.,LTD.



CONTENTS

1.Attenuation Characteristics	1
2.Leakage Current	3
3.Figure of Testing Circuitry	4

(Final Page 4)

COSEL

Model TBC-150-□□□


Temperature 25°C
Testing Circuitry Figure A

Item Attenuation Characteristics

Object


TBC-150-223

— Differential Mode
 — Common Mode

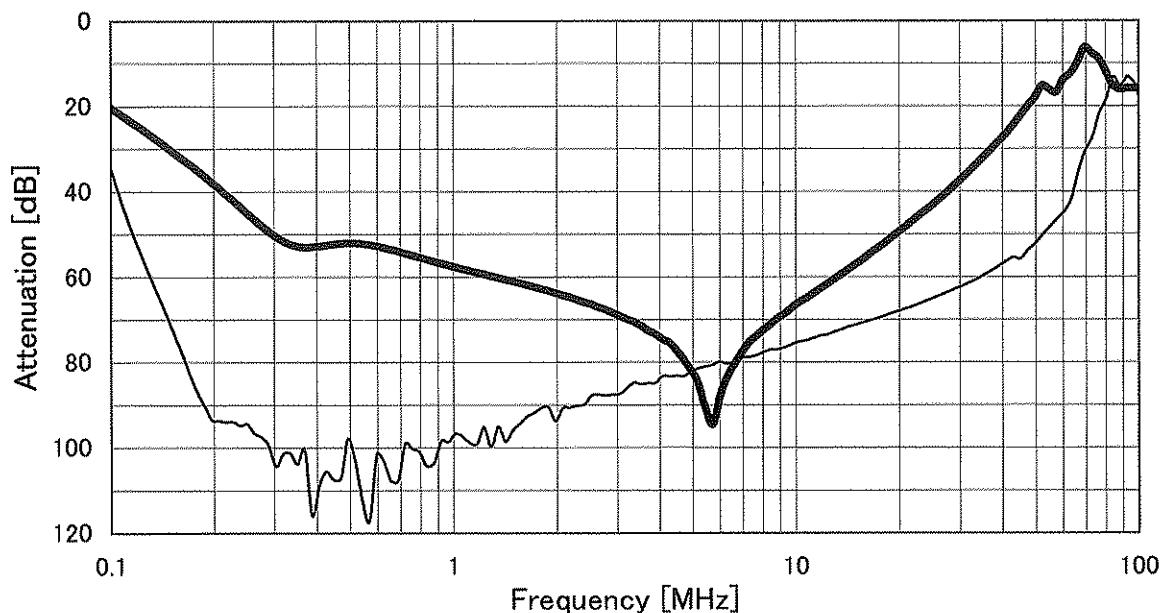

TBC-150-683

— Differential Mode
 — Common Mode

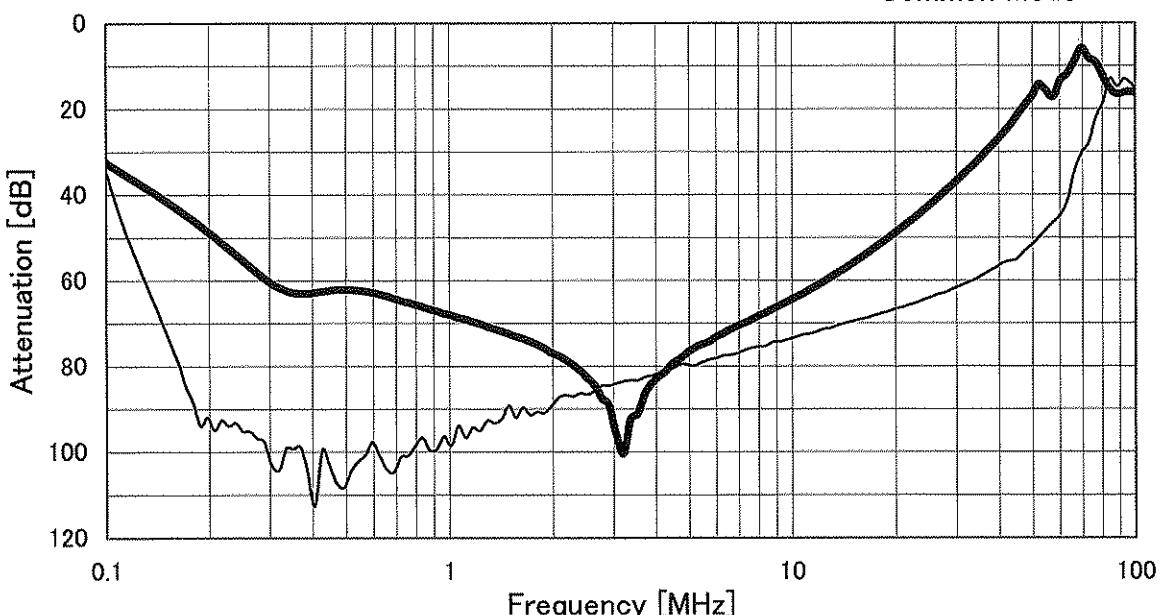


COSEL

Model TBC-150-□□□

Temperature 25°C
Testing Circuitry Figure A

Item Attenuation Characteristics

Object _____

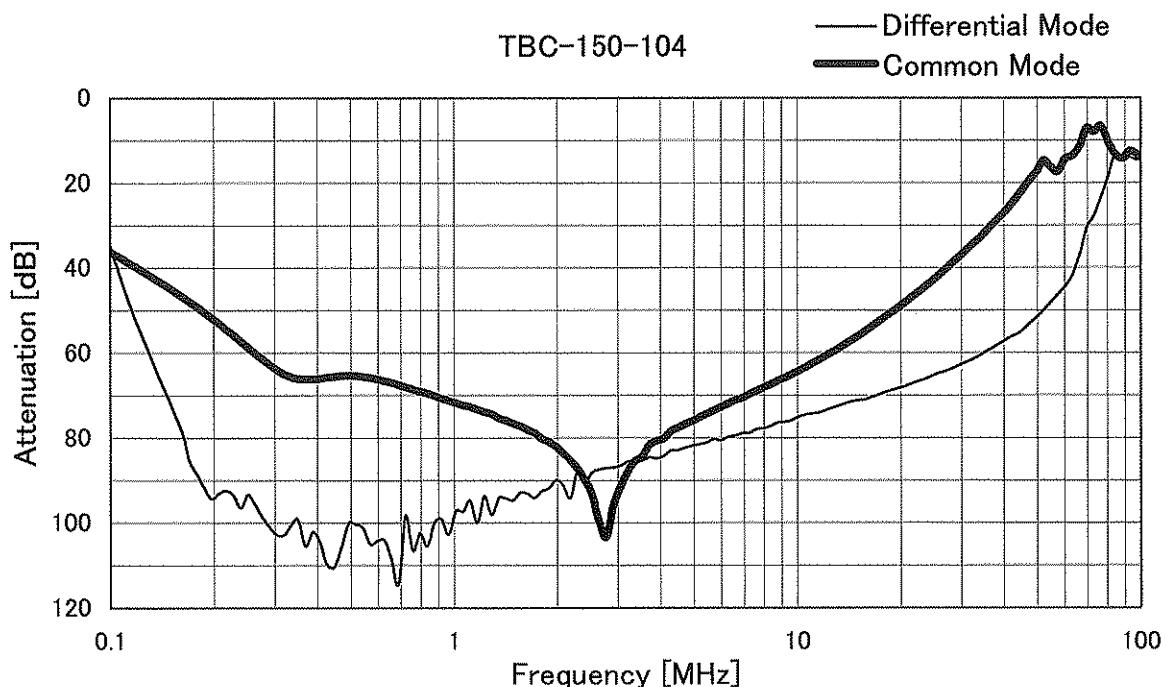



Model	TBC-150-□□□	Temperature Testing Circuitry	25°C Figure B	
Item	Leakage Current			
Object	_____			

1. Results

[mA]

Model	Standards	Input Volt.					Note
		200 [V]	250 [V]	400 [V]	480 [V]	500 [V]	
TBC-150-223	UL1283	0.52	0.69	1.2	1.4	1.4	
TBC-150-683	UL1283	1.4	1.8	2.8	3.5	3.6	
TBC-150-104	UL1283	2.1	2.6	4.3	5.1	5.3	

2. Condition

Leakage current value is concluded after measuring both phases of AC input and by choosing the larger one.

COSEL

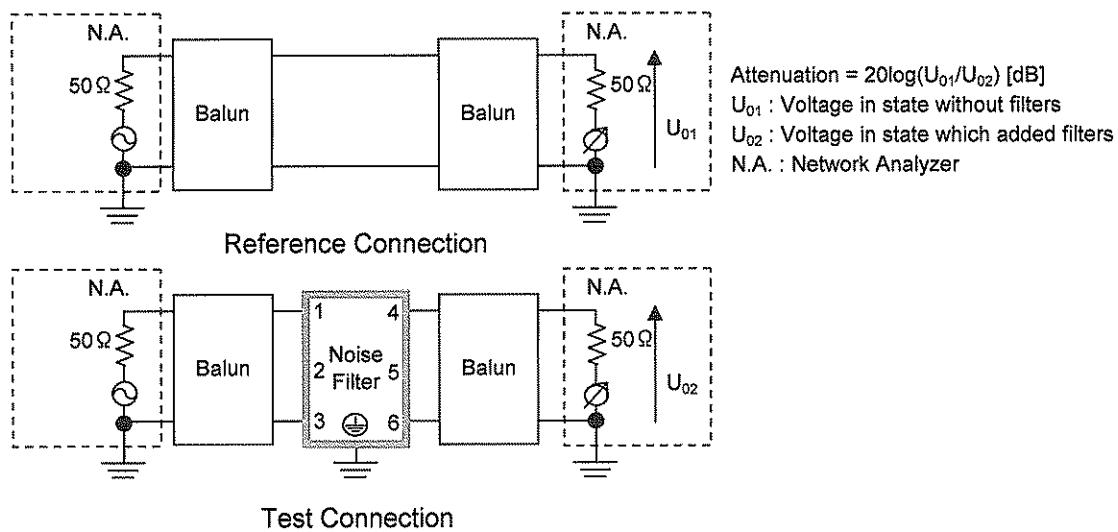


Figure A - 1 Differential mode attenuation measurement

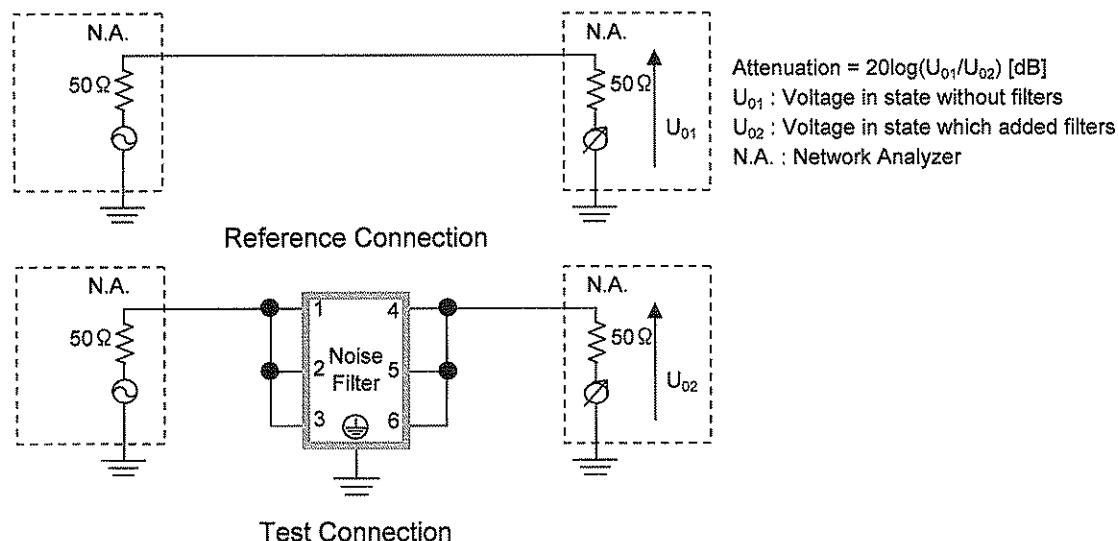


Figure A - 2 Common mode attenuation measurement

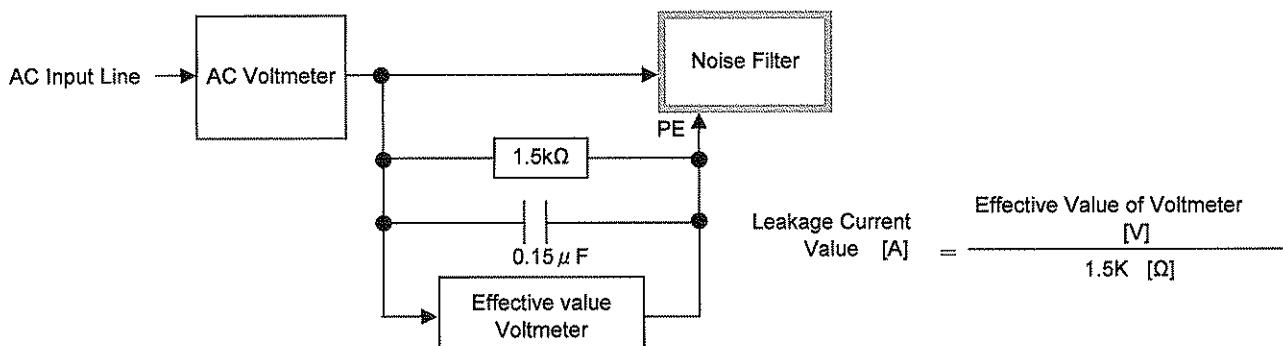


Figure B Leakage current measurement (UL1283)